
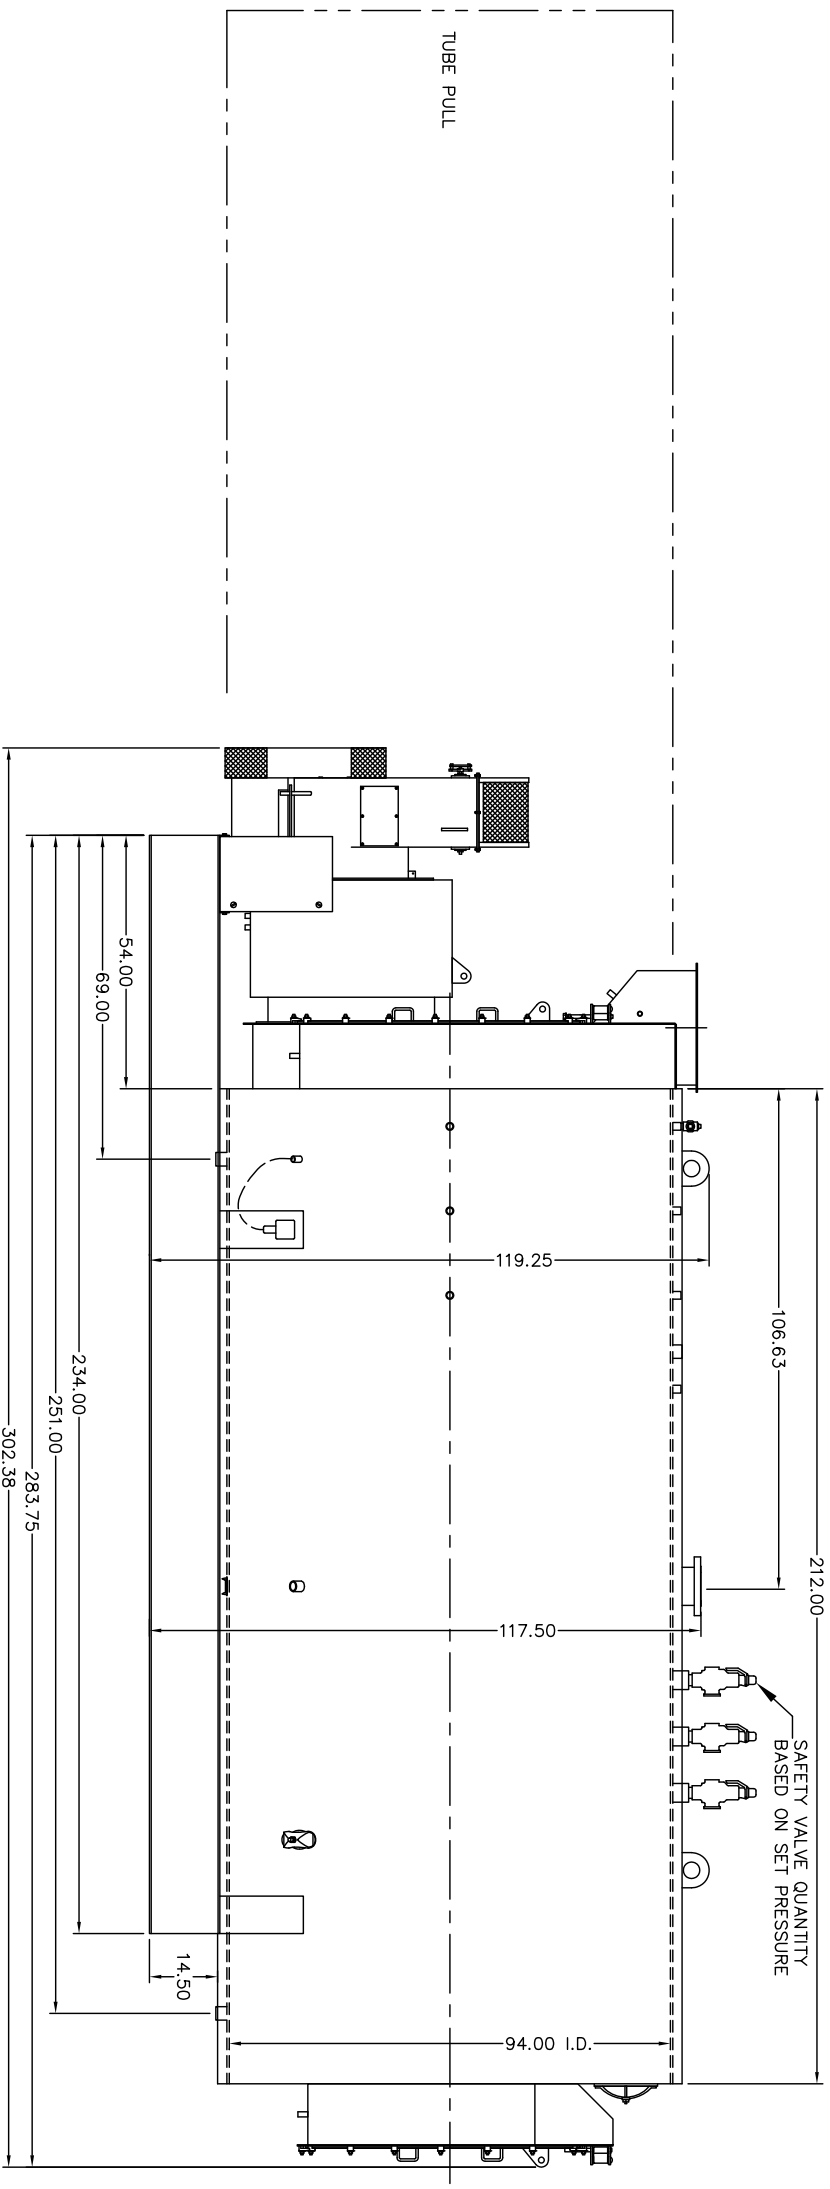
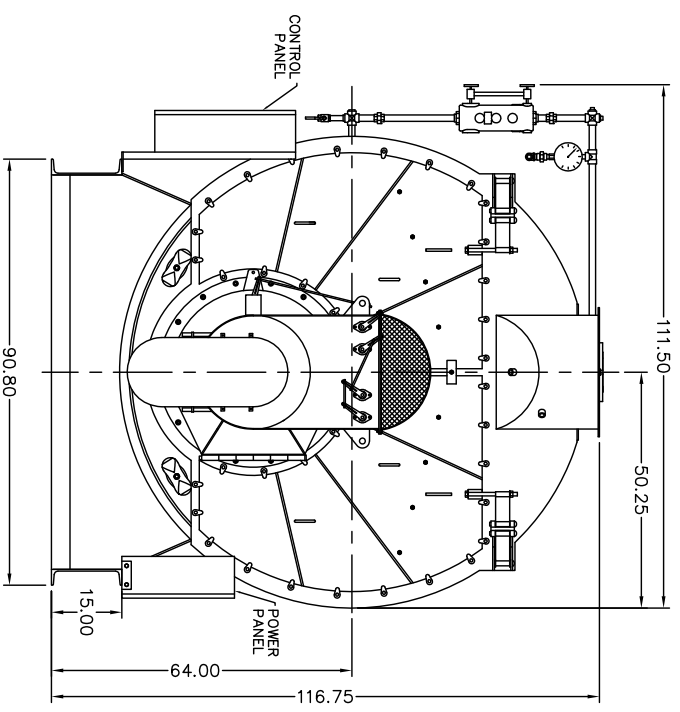


NOTES:

1. MINIMUM AISLE CLEARANCE 36" FROM BOILER SIDES AND REAR. (THIS REQUIREMENT MAY VARY WITH LOCATION. CHECK STATE AND LOCAL CODES IN THE AREA OF INSTALLATION.)
2. OPTIONS AND ADDITIONAL EQUIPMENT ORDERED MAY AFFECT OVERALL DIMENSIONS. DRAWINGS ARE FOR STANDARD BOILER PACKAGE.

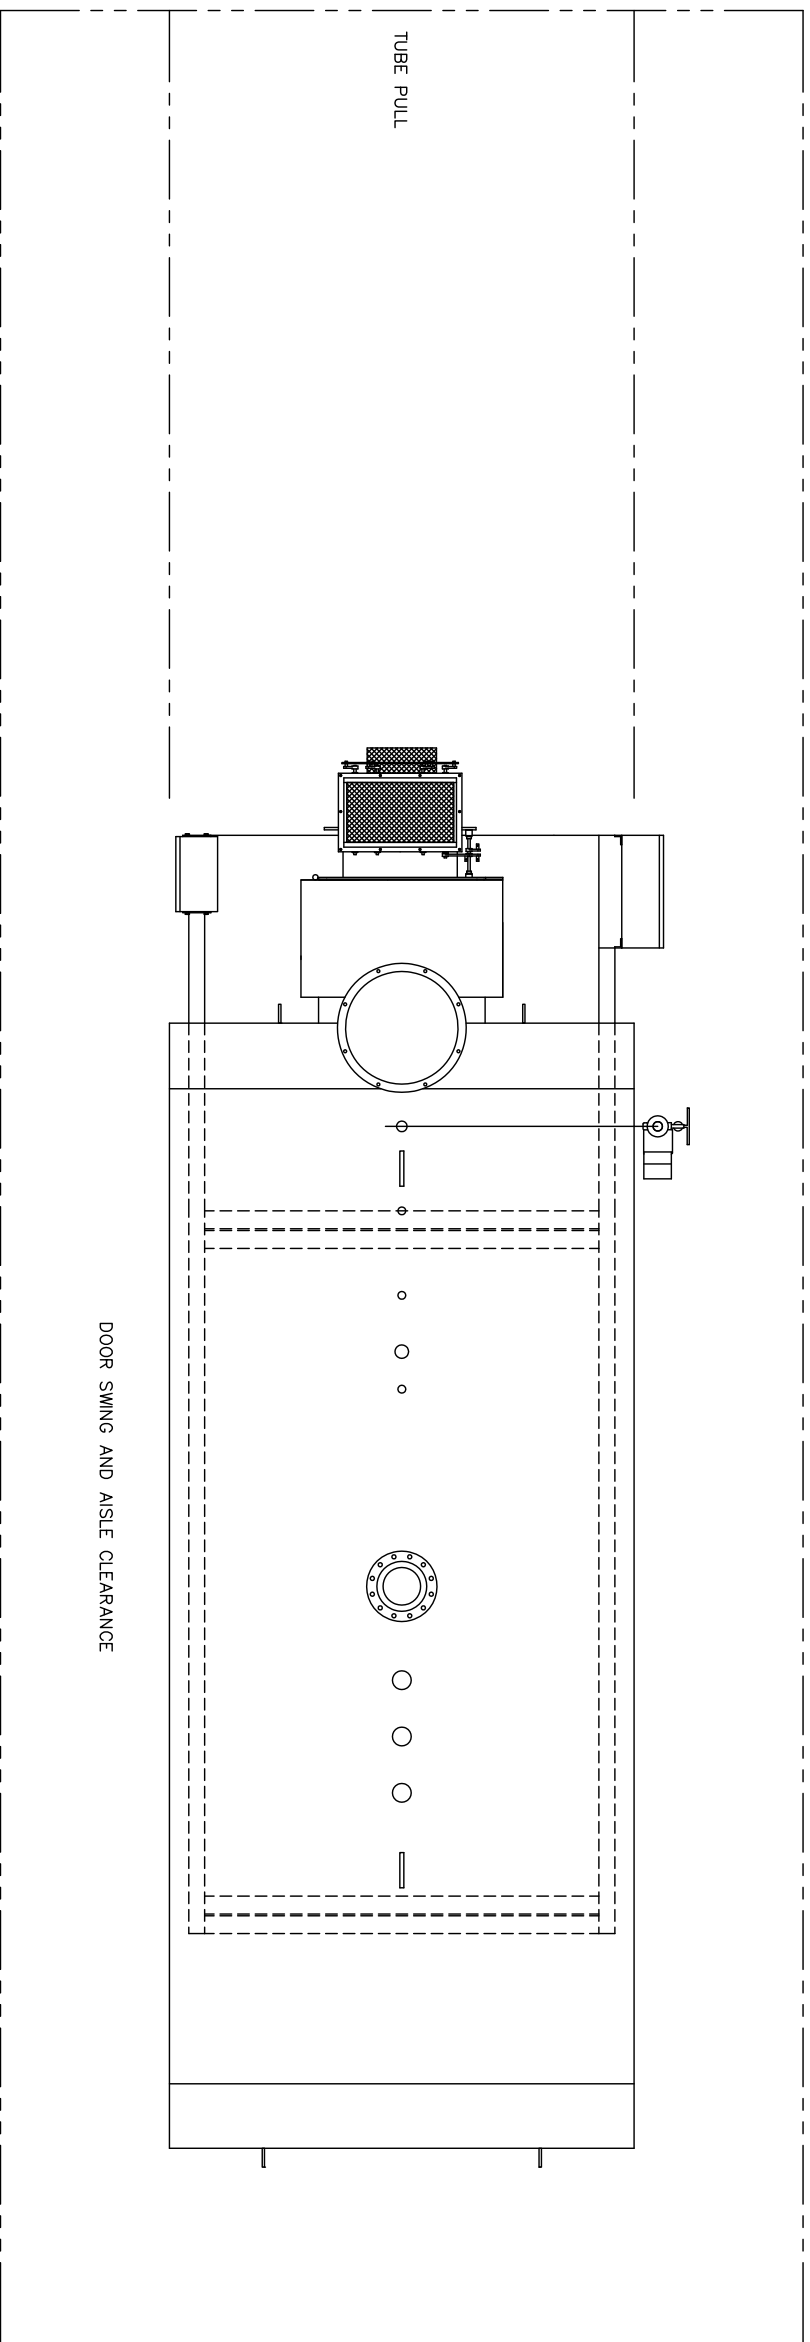

DWG NO. 300B0362

REVISIONS

A 1-18-07 JRS


ADDED PANELS, UPDATED BURNER, CHANGED STACK OUTLET, ADDED TOP CENTERLINE CONNECTIONS.

B 3-19-10 CW

REV'D SAFETY VALVE LOCATION.

REFERENCE DRAWINGS:

- BLWR HOUSING: #235A0132
- PLENUM: #212B0170
- PV BASE: #101B0715
- FR FLUE BOX: #201B0215
- RR FLUE BOX: #205B0153
- #206B0149



THIS DRAWING IS THE PROPERTY OF THE JOHNSTON BOILER COMPANY. THE DISCLOSURES CONTAINED ON THIS DRAWING ARE MADE WITH THE UNDERSTANDING THAT THEY ARE CONFIDENTIAL AND WILL NOT BE USED IN ANY WAY DETRIMENTAL TO THIS COMPANY'S INTEREST.

SCALE	CAD/FULL	DATE	8-24-00
DRAWN	CSP	CHECKED	
APPROVED			
<p>JOHNSTON BOILER COMPANY FERRYSBURG, MICHIGAN 49409</p>			
<p>BOILER TEMPLATE - 509 PFTA500-4-150#S</p>			
<p>DWG. NO. 300B0362-01</p>			

SO#
REV B