
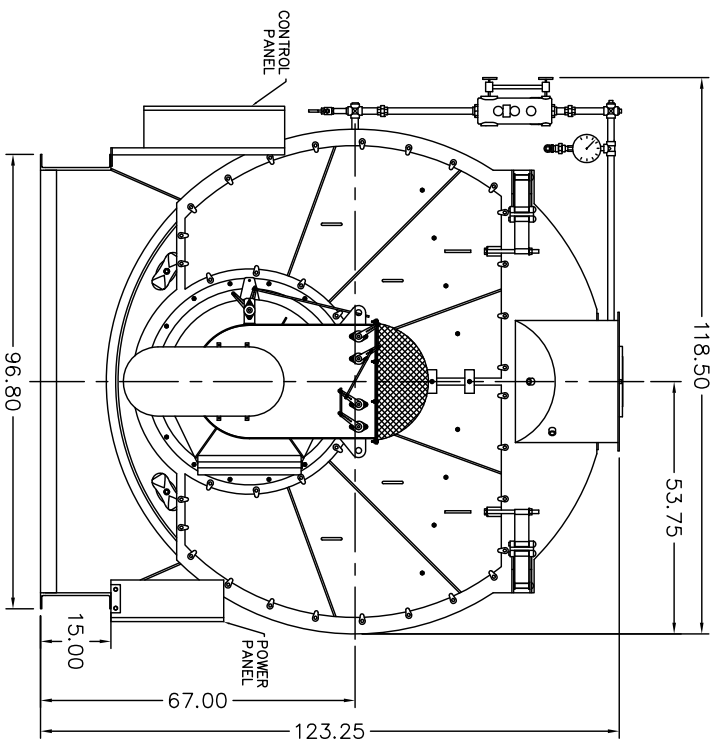
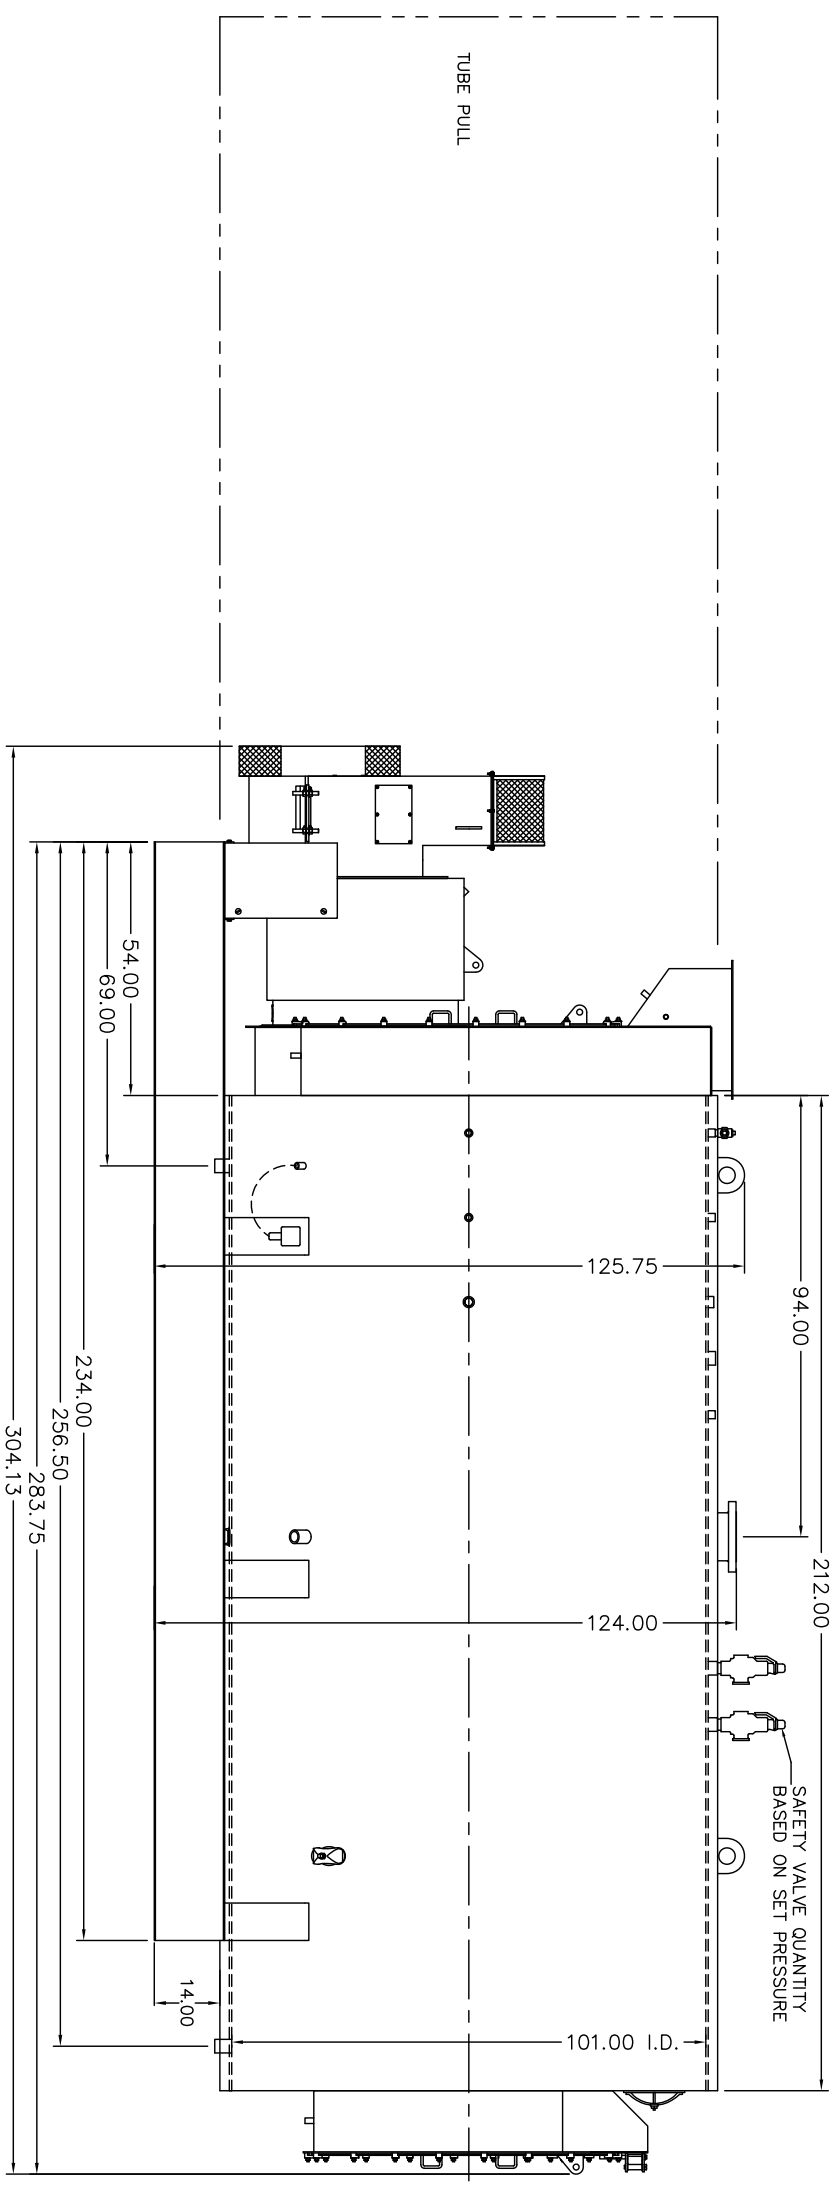



NOTES:

1. MINIMUM AISLE CLEARANCE 36" FROM BOILER SIDES AND REAR. (THIS REQUIREMENT MAY VARY WITH LOCATION. CHECK STATE AND LOCAL CODES IN THE AREA OF INSTALLATION.)
2. OPTIONS AND ADDITIONAL EQUIPMENT ORDERED MAY AFFECT OVERALL DIMENSIONS. DRAWINGS ARE FOR STANDARD BOILER PACKAGE.

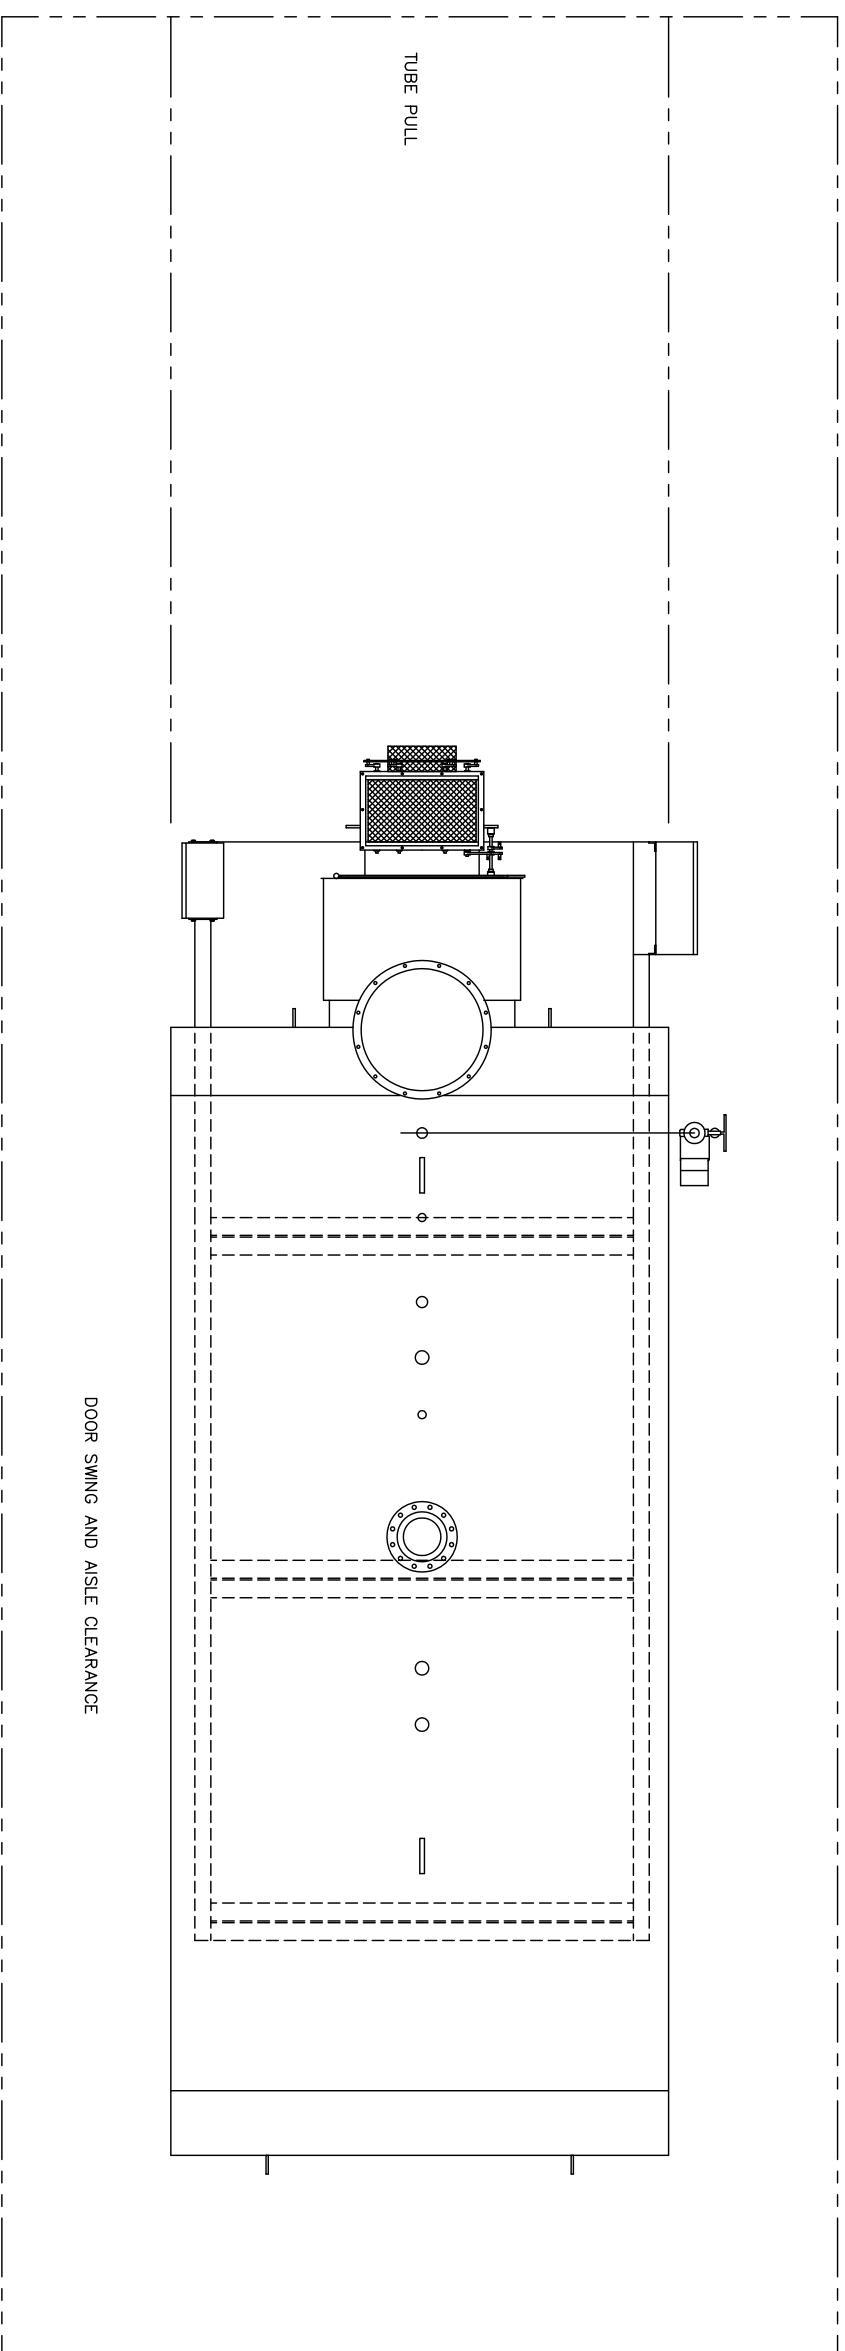

DWG NO. 300B0368		
REVISIONS		
A	03-30-01	CSP
ADDED INFO. TO NOTE #1		
B	08-16-06	MN
SAFETY VALVE COUPLINGS WERE INLINE.		
C	1-22-07	JRS
UPDATED BURNER, CHANGED FLUEBOX OUTLET, CHANGED, UPDATED TUBE PULL, ADDED PANELS.		
D	3-19-10	CW
REV'D SAFETY VALVE LOCATION.		

REFERENCE DRAWINGS
 BLWR HOUSING: #235A0132-05
 PLENUM: #212B0150
 PV: #101B0741
 PV BASE: #201B0233
 FR FLUE BOX: #205B0148
 RR FLUE BOX: #206B0138



THIS DRAWING IS THE PROPERTY OF THE JOHNSTON BOILER COMPANY. THE DISCLOSURES CONTAINED ON THIS DRAWING ARE MADE WITH THE UNDERSTANDING THAT THEY ARE CONFIDENTIAL AND WILL NOT BE USED IN ANY WAY DETRIMENTAL TO THIS COMPANY'S INTEREST.

SCALE	CAD/FULL	DATE	8-24-00	PREPARED BY	CSP	CHECKED BY	APPROVED BY
JOHNSTON BOILER COMPANY FERRYSBURG, MICHIGAN 49409 BOILER TEMPLATE - 509 PFTA600-4-150#S DWG. NO. 300B0368-01							
REV	D						