
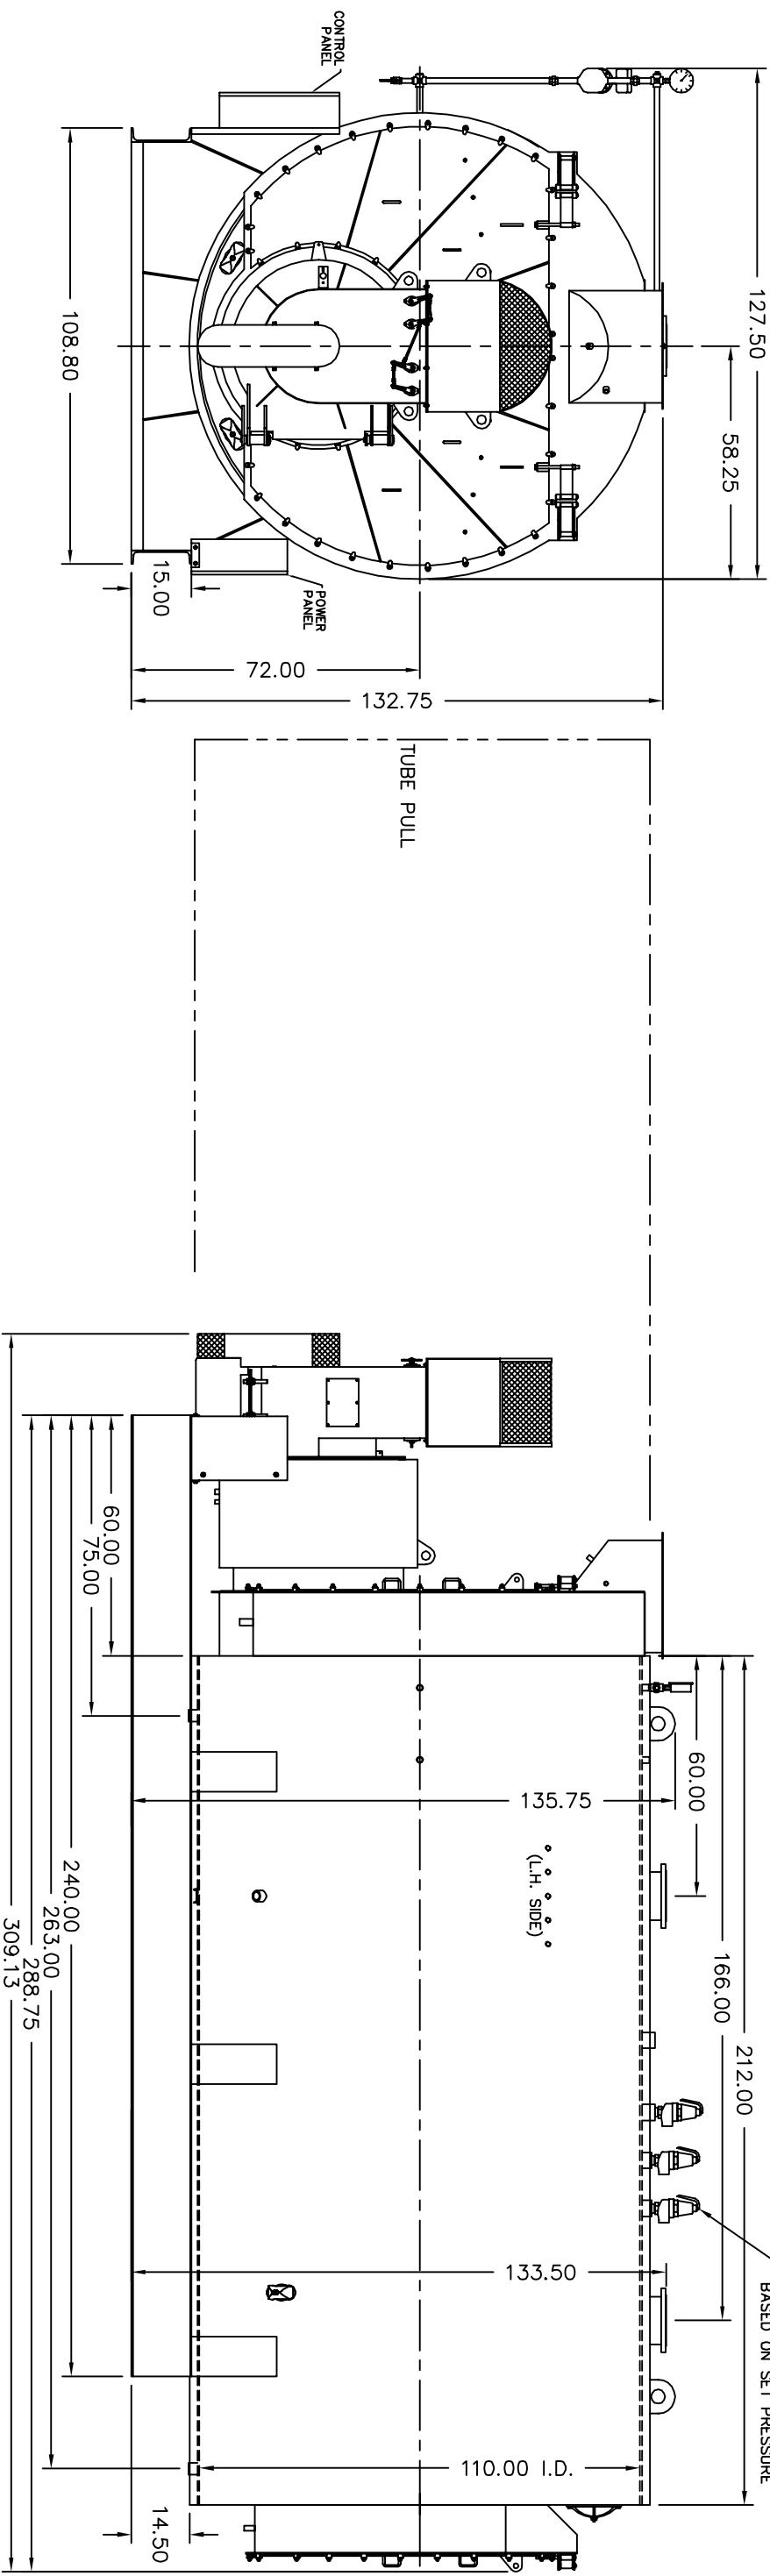


NOTES:

1. MINIMUM AISLE CLEARANCE 36" FROM BOILER SIDES AND REAR. (THIS REQUIREMENT MAY VARY WITH LOCATION. CHECK STATE AND LOCAL CODES IN THE AREA OF INSTALLATION.)
2. OPTIONS AND ADDITIONAL EQUIPMENT ORDERED MAY AFFECT OVERALL DIMENSIONS. DRAWINGS ARE FOR STANDARD BOILER PACKAGE.

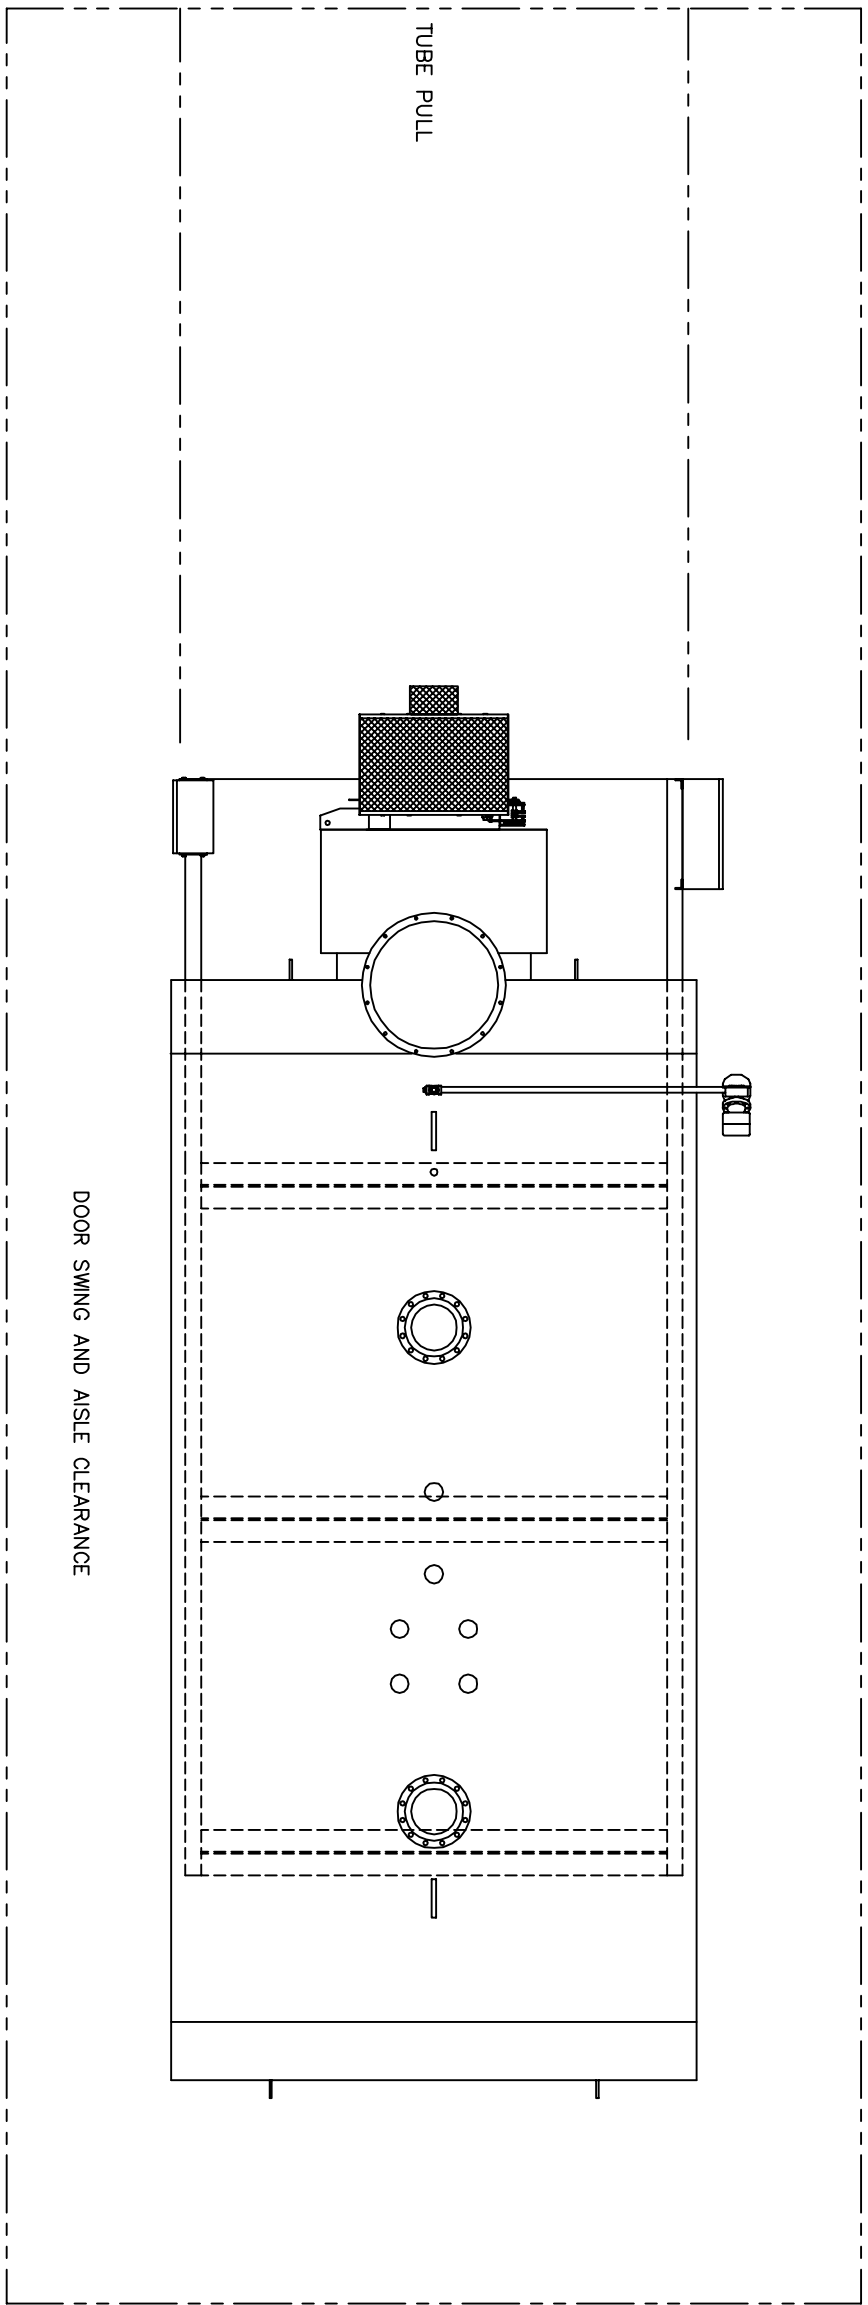

DWG NO. 300B0460

REVISIONS

NO.	DESCRIPTION

REFERENCE DRAWINGS

BLWR HOUSING: #216B01222


PLENUM: #212B01566

P.V. BASE: #101B09442

FR FLUE BOX: #201B0251

RR FLUE BOX: #205B0149

#206B0139



THIS DRAWING IS THE PROPERTY OF THE JOHNSTON BOILER COMPANY. THE DISCLOSURES CONTAINED ON THIS DRAWING ARE MADE WITH THE UNDERSTANDING THAT THEY ARE CONFIDENTIAL AND WILL NOT BE USED IN ANY WAY DETRIMENTAL TO THIS COMPANY'S INTEREST.

SCALE	CAD/FULL	DATE	2-26-07
DRAWN	DRS	CHECKED	
APPROVED			
<p>JOHNSTON BOILER COMPANY</p> <p>FERRYSBURG, MICHIGAN 49409</p> <p>BOILER TEMPLATE - 509</p> <p>PFTA750-4-30#W</p>			
DWG NO.	300B0460-01		
REV			