
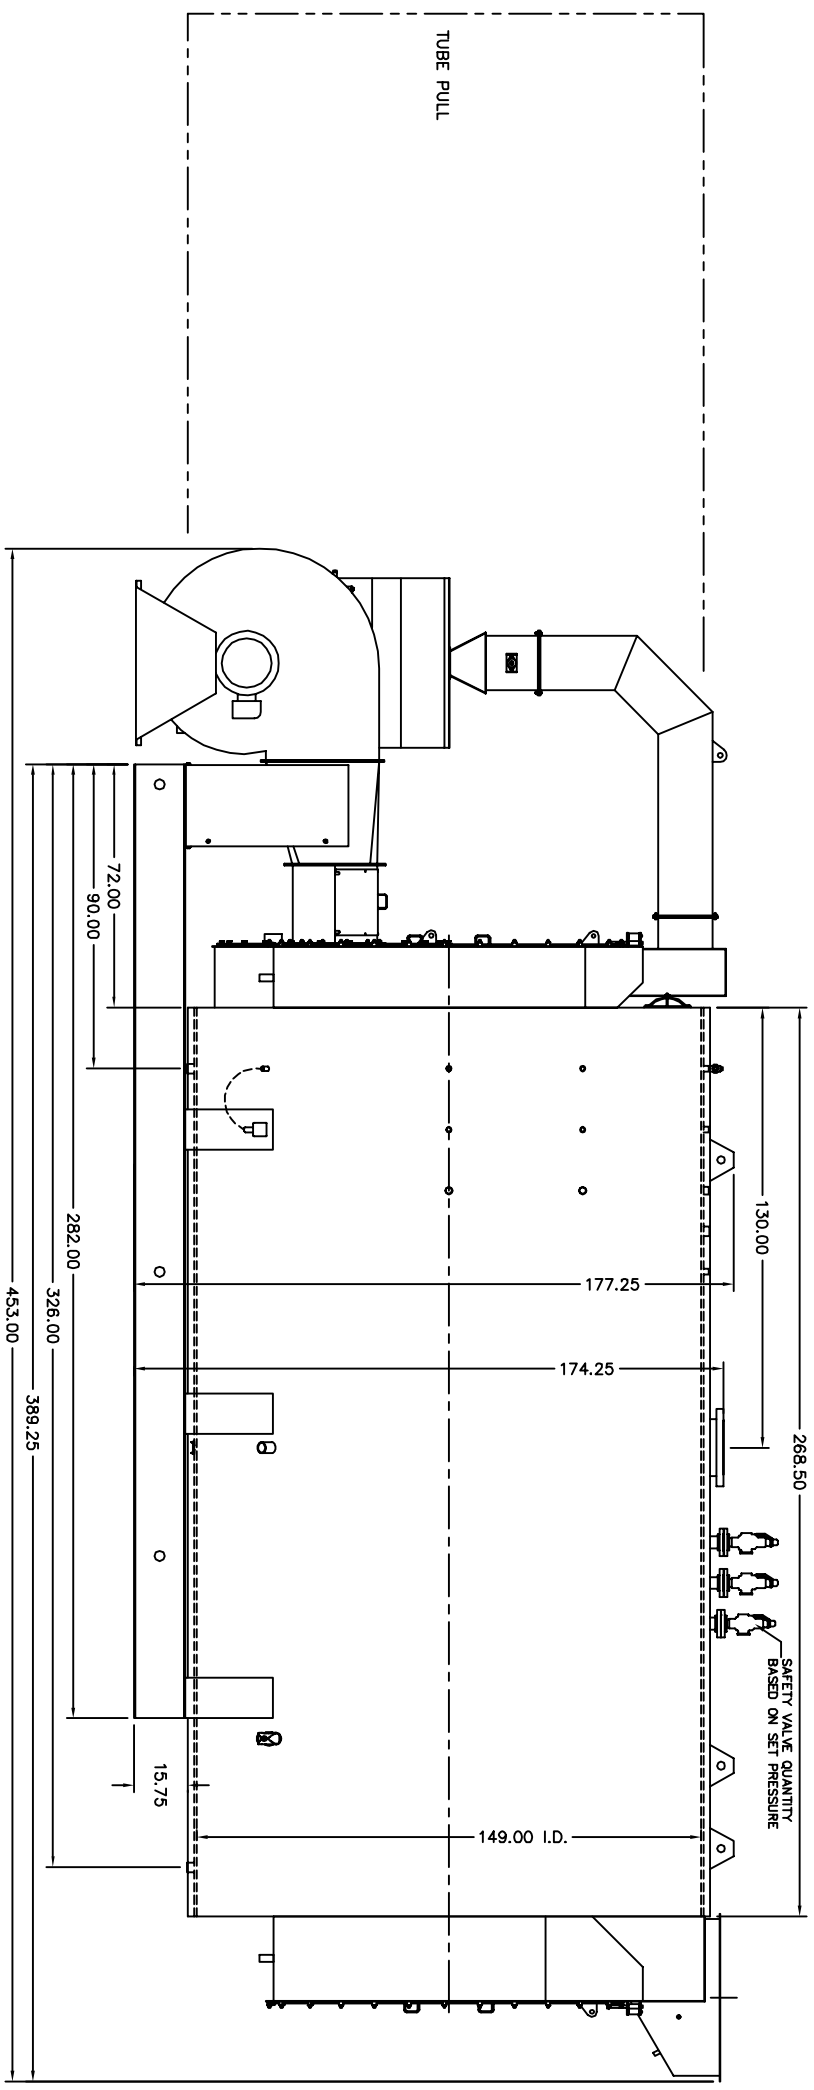
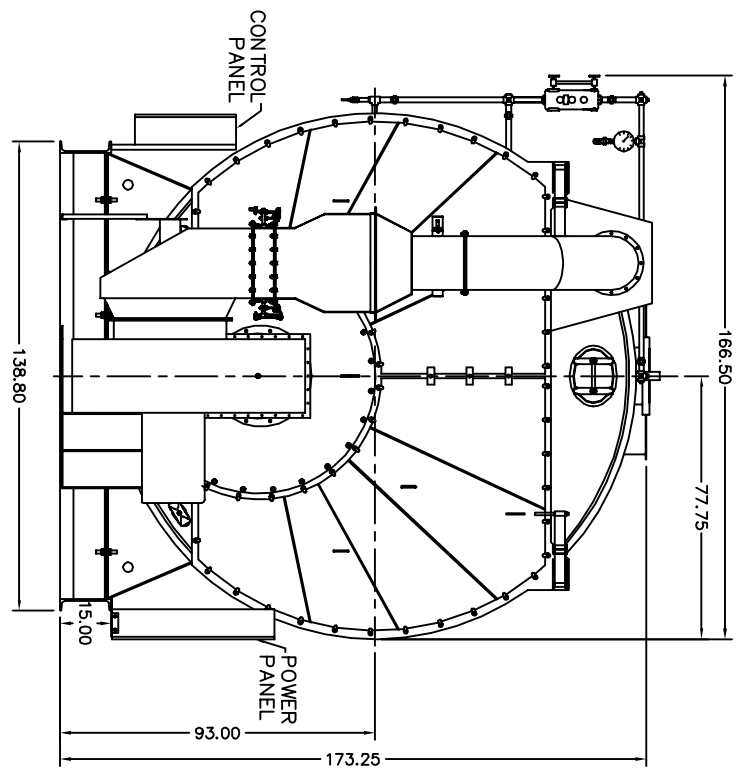


- NOTES:
1. MINIMUM AISLE CLEARANCE 36" FROM BOILER SIDES AND REAR. (THIS REQUIREMENT MAY VARY WITH LOCATION. CHECK STATE AND LOCAL CODES IN THE AREA OF INSTALLATION.)
  2. OPTIONS AND ADDITIONAL EQUIPMENT ORDERED MAY AFFECT OVERALL DIMENSIONS. DRAWINGS ARE FOR STANDARD BOILER PACKAGE.

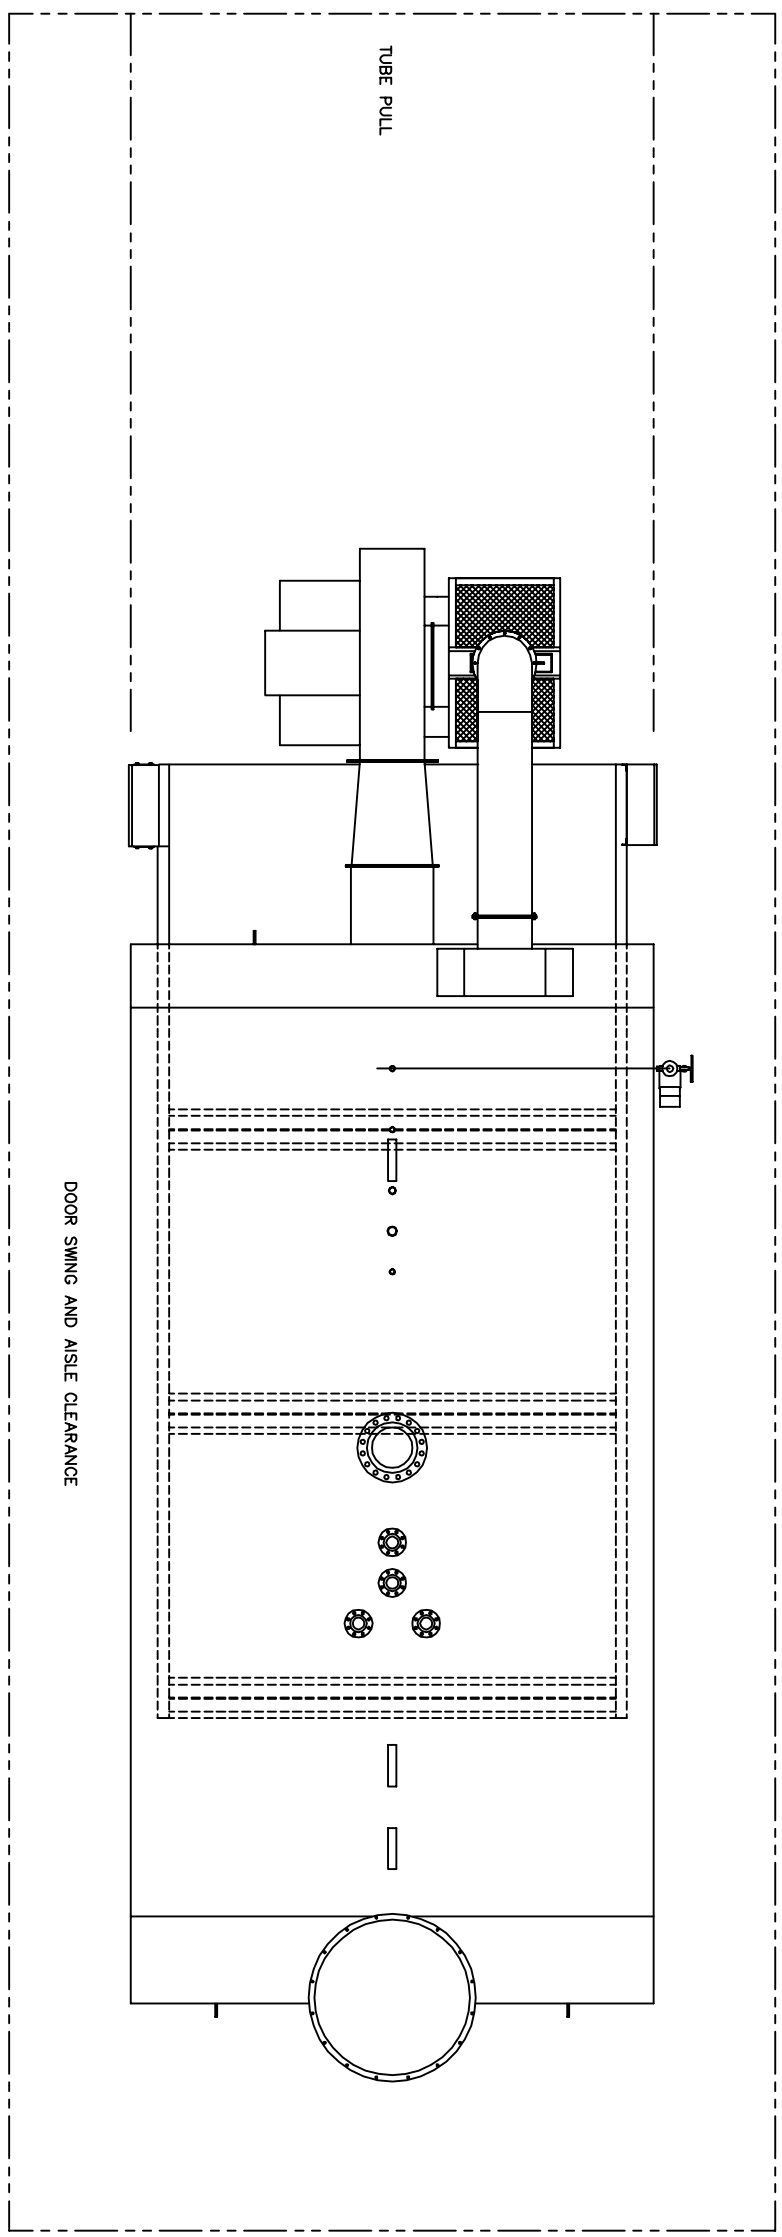


DWG NO. 300B0448

REVISIONS

NO.	DATE	DESCRIPTION

REFERENCE DRAWINGS:  
 PV BASE: #2018B0051  
 FR FLUE BOX: #2098B0115  
 RR FLUE BOX: #2068B0128  
 PLENUM: #2128B0120



THIS DRAWING IS THE PROPERTY OF THE JOHNSTON BOILER COMPANY. THE DISCLOSURES CONTAINED ON THIS DRAWING ARE MADE WITH THE UNDERSTANDING THAT THEY ARE CONFIDENTIAL AND WILL NOT BE USED IN ANY WAY DETRIMENTAL TO THIS COMPANY'S INTEREST.

SCALE: CAD/FULL  
 DATE: 1-31-07  
 DRAWN: JRS  
 CHECKED: [Signature]  
 APPROVED: [Signature]

JOHNSTON BOILER COMPANY  
 FERRYSBURG, MICHIGAN 49409  
 BOILER TEMPLATE - 509  
 PFTS2500-3-150#S

DWG NO. 300B0448-02  
 REV