



# MODEL: PFTX 125-4

## Nozzle Loadings


Maximum Allowable Load on Boiler Steam Nozzle					
	15# Design	150# Design	200# Design	250# Design	300# Design
$F_{RRF}$ , lb	4,030	1,280	1,280	2,135	2,135
$M_{RCM}$ , in-lb	19,615	8,645	8,645	14,800	14,800
$M_{RLM}$ , in-lb	30,560	6,655	6,655	13,355	13,355

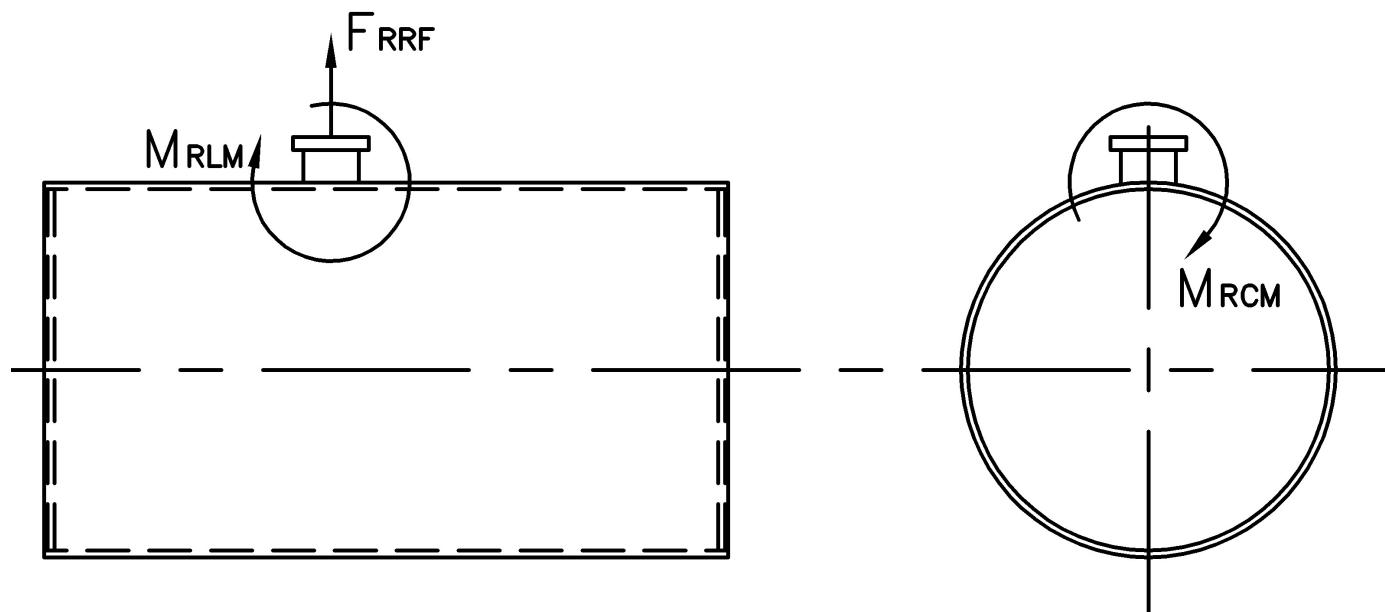

Distributed By:




300 Pine Street  
P.O. Box 300  
Ferrysburg, MI 49409-0300  
Telephone: (616) 842-5050  
Net: www.johnstonboiler.com



# MODEL: PFTX 125-4

## 4-Pass Steam Packaged Firetube Boiler

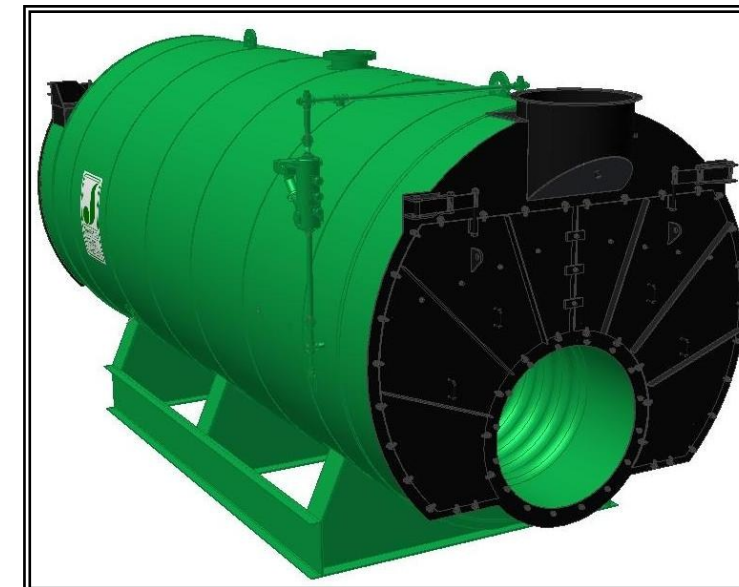

## Ratings & Performance Data


Horsepower 125			
Steam Storage, ft <sup>3</sup>	28.9	Natural Gas Flow, SCFH (1,000 Btu/ft <sup>3</sup> )**	5,116
Steam Disengaging Area, ft <sup>2</sup>	39.9	Combustion Air (15% Excess), SCFM***	936
Total Heating Surface, ft <sup>2</sup>	652	Flue Gas Flow Rate, lb/hr***	4,461
Furnace Outside Diameter, in	30.5	Stack Flue Gas Velocity, ft/min***	1,534
Furnace Heat Release Rate, Btu/ft <sup>3</sup> hr**	163,000	#2 Oil Flow, gal/hr (140,000 BTU/gal)**	35.2
Total Combustion Volume, ft <sup>3</sup>	52.5	#6 Oil Flow, gal/hr (150,000 BTU/gal)**	32.5
Total Heat Release Rate, Btu/ft <sup>3</sup> hr**	97,000	Flue Gas Side Pressure Drop, in. H <sub>2</sub> O	2.6
Water Content N.W.L., gal	961	Water Content Flooded, gal.	1,177
Approx. Dry Weight 15#, lb	13,000	Approx. Operating Weight 15#, lb.	21,000
Approx. Dry Weight 150#, lb	13,800	Approx. Operating Weight 150#, lb.	21,800
Approx. Dry Weight 200#, lb	14,900	Approx. Operating Weight 200#, lb.	22,900
Approx. Dry Weight 250#, lb	15,800	Approx. Operating Weight 250#, lb.	23,800
Approx. Dry Weight 300#, lb	16,700	Approx. Operating Weight 300#, lb.	24,700

Performance Data*							
Operating Pressure (psig)	Steam Rate (lb/hr)	Natural Gas		#2 Oil		#6 Oil	
		Stack Temp (F)	%Eff	Stack Temp (F)	%Eff	Stack Temp (F)	%Eff
10	4,342	294	84.3	303	87.4	288	88.3
50	4,262	351	82.8	360	85.9	349	86.8
100	4,220	391	81.8	400	84.8	392	85.8
150	4,197	419	81.1	428	84.1	422	85.0
200	4,184	441	80.5	450	83.5	446	84.4
250	4,176	459	80.0	468	83.0	466	83.9
300	4,172	475	79.6	484	82.6	483	83.5


\*Based on 228°F feedwater and 3% O<sub>2</sub>, \*\* Values calculated at 100 psi operating pressure, \*\*\*Calculated Firing Natural Gas

Connection & Opening Schedule			
Conn.	Description	Type	Qty
FW	Feedwater Inlet	1.50 FNPT	2
MS*	Main Steam	4.00 300# RF	1
CB	Continuous Blowoff	1.00 FNPT	1
BD	Blowdown Outlet	1.50 FNPT	2
MW	Manway	12 X 16	1
HH	Hand Hole	4 X 6	6

\*8.00 150#RF Flange on 15 psig Design


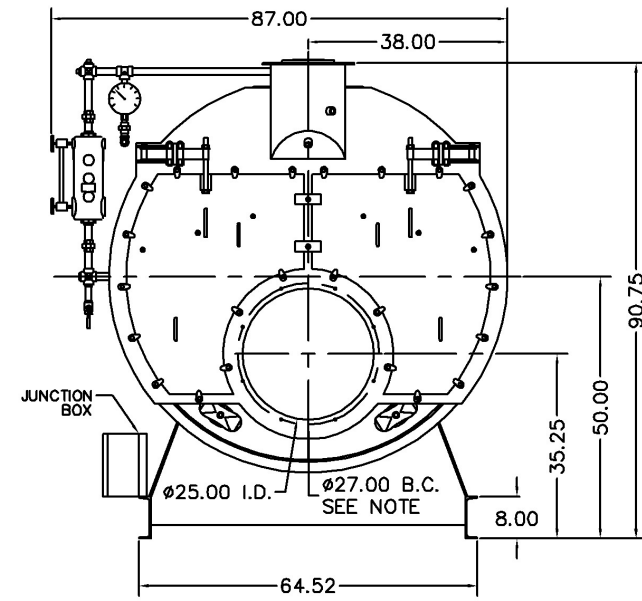


NOTE: (8) 1/2 UNC X 1.375 LONG STUDS EQUALLY SPACED STRADDLE CENTERLINES. STUDS FOR BURNER REFRACTORY (DRY OVEN) MOUNTING. REFRACTORY MUST EXTEND 12.50" MINIMUM PAST MOUNTING FLANGE.

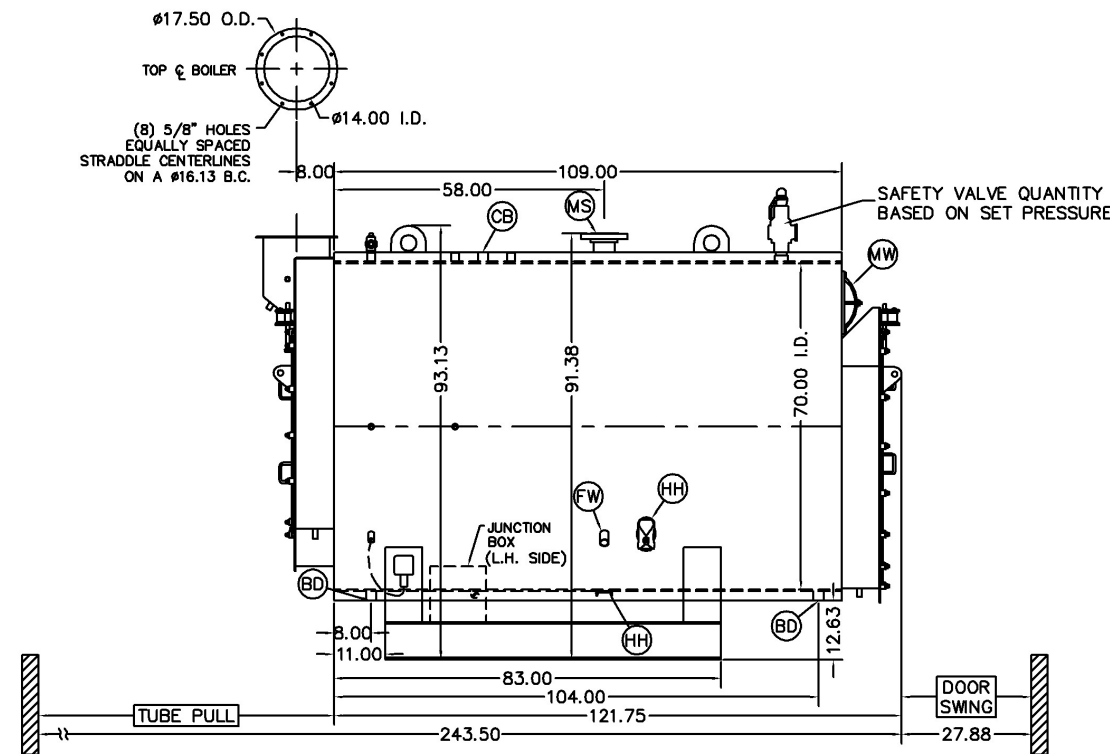

Notes:  
 150# Steam design shown, all dimensions given in inches.  
 Fuel piping and/or optional boiler trim may increase overall width.  
 Specifications subject to change to incorporate engineering advances.

Base Diagram

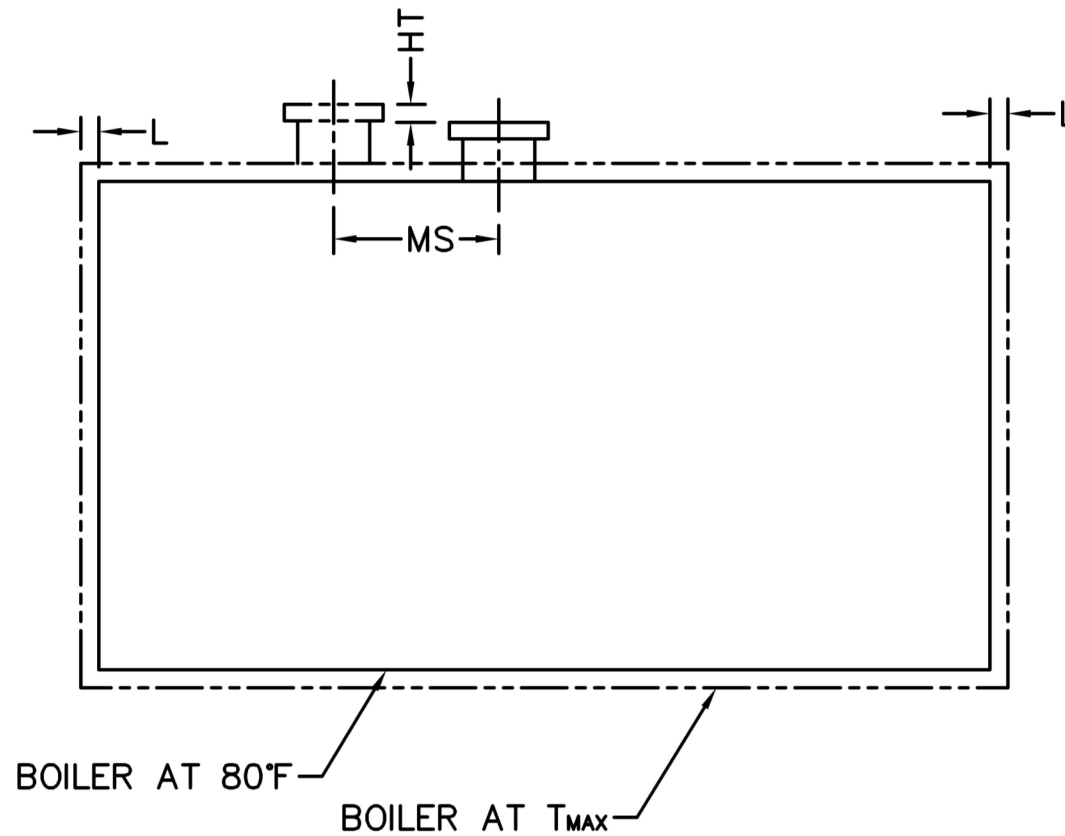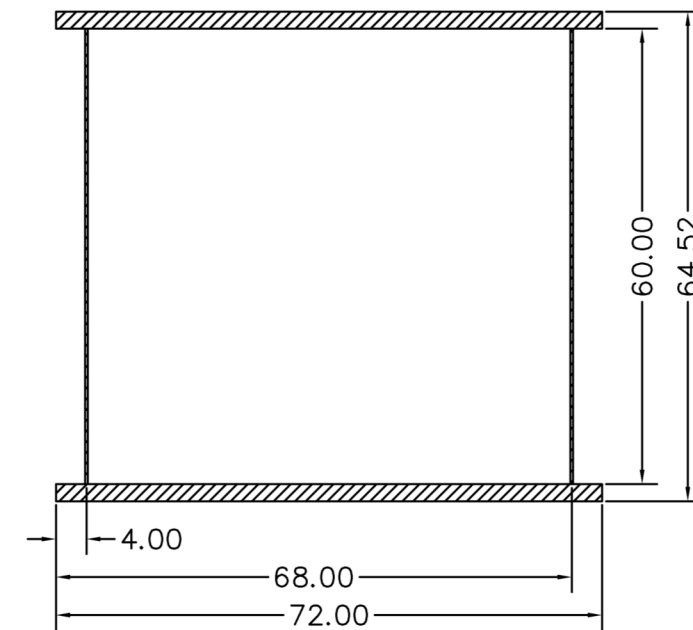

Thermal Expansion					
psig	15	150	200	250	300
Metal T <sub>MAX</sub> (F)	240	366	388	406	421
L (in)	0.055	0.093	0.101	0.107	0.112
MS (in)	0.004	0.006	0.006	0.007	0.007
HT (in)	0.072	0.121	0.130	0.138	0.145