
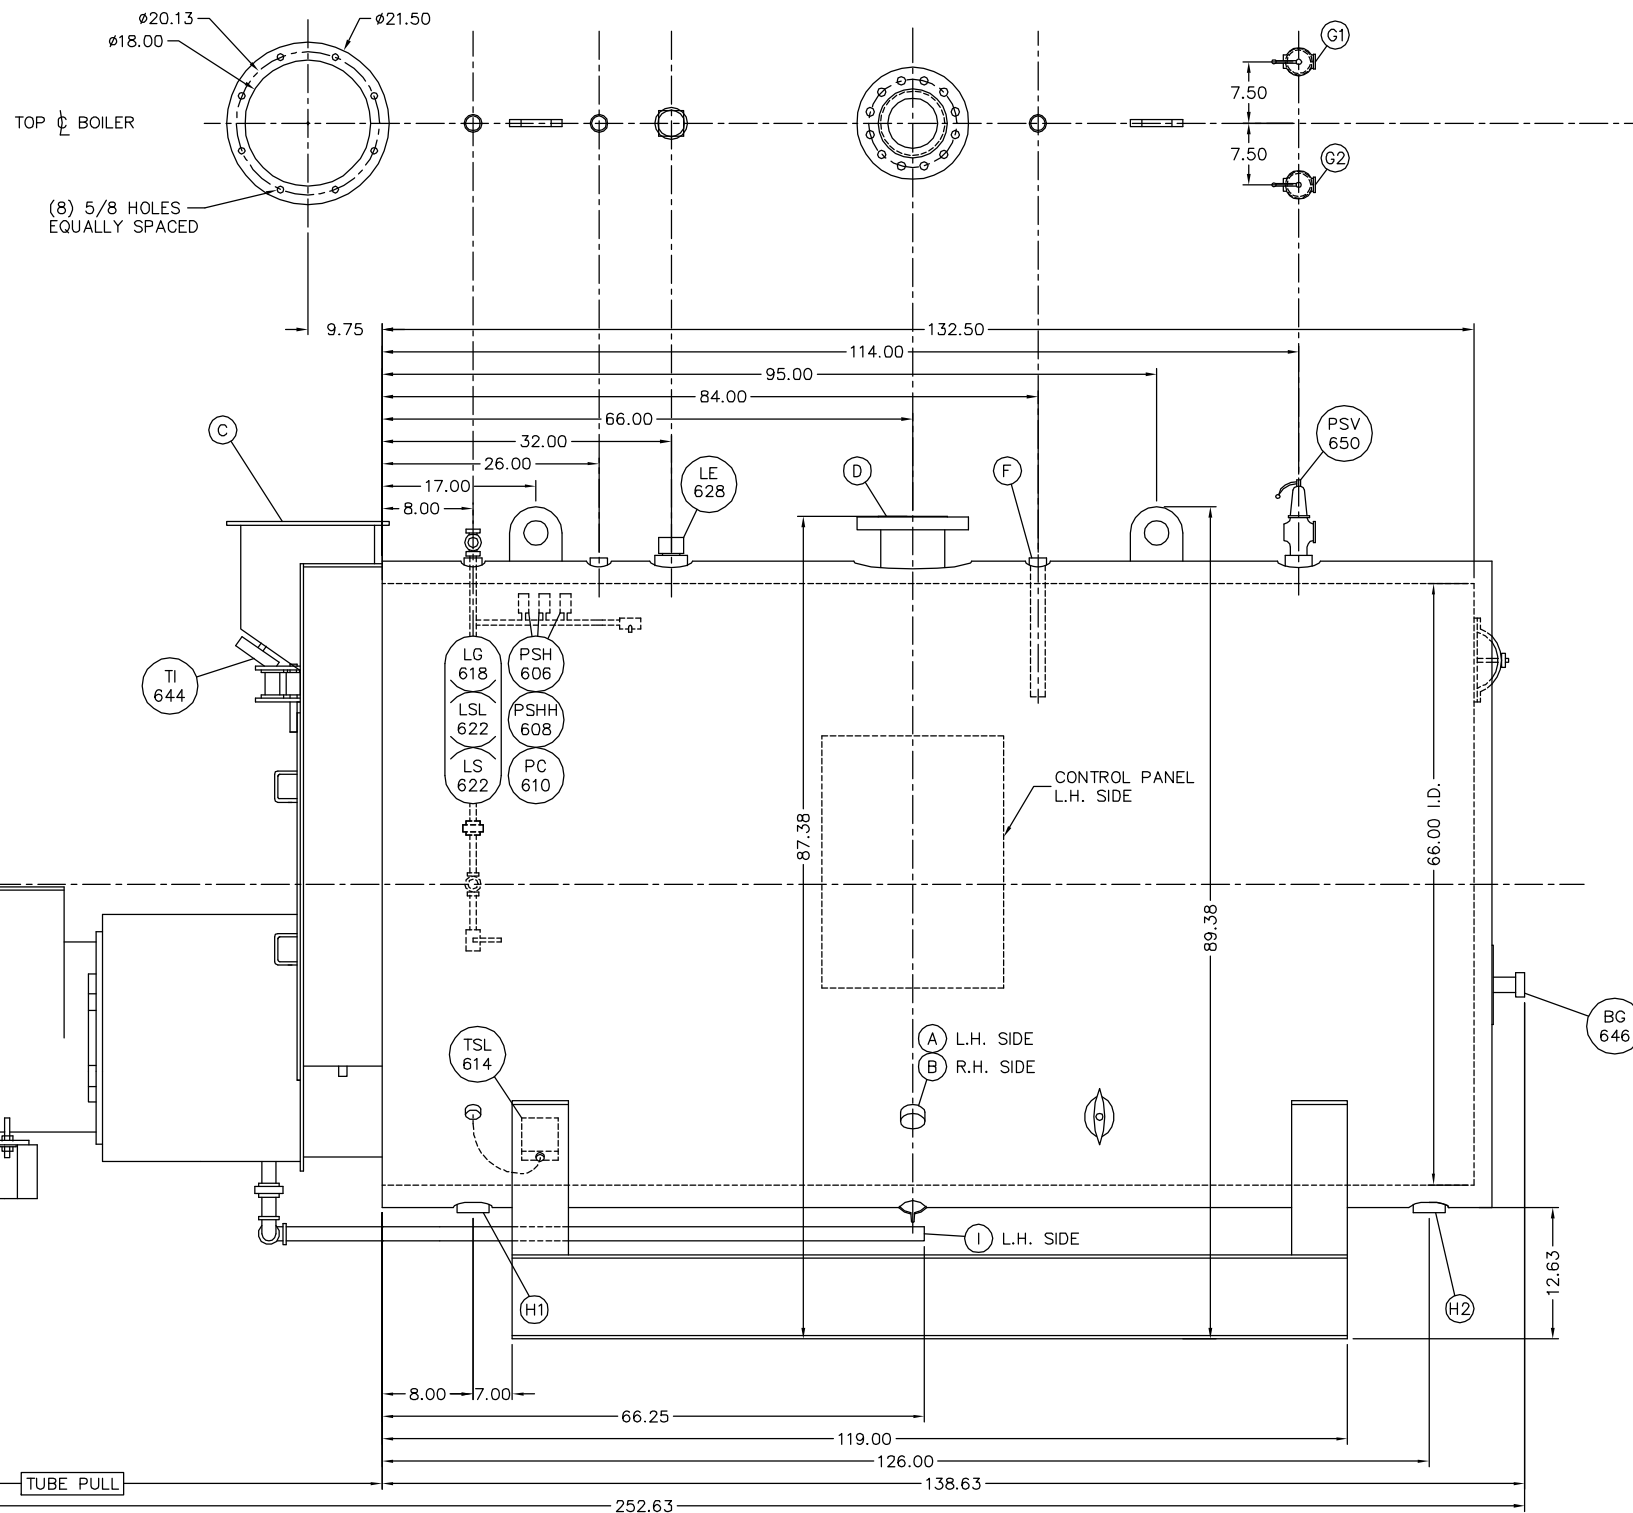


CONNECTION SCHEDULE

CONN.	DESCRIPTION	SIZE	TYPE
A	FEEDWATER INLET	1.50	FNPT
B	AUX. FEEDWATER INLET	1.50	FNPT
C	FLUE OUTLET	18.00	ID
D	MAIN STEAM OUTLET	6.00	300#RF
F	CONTINUOUS BLOWOFF OUTLET	1.00	FNPT
G	SAFETY VALVE OUTLET	2.00	FNPT
H	BLOWDOWN OUTLET	2.00	FNPT
I	MAIN GAS INLET	2.50	FNPT
J	MAIN GAS VENT VALVE OUTLET	1.50	FNPT
L	PILOT GAS VENT VALVE OUTLET	0.38	FNPT

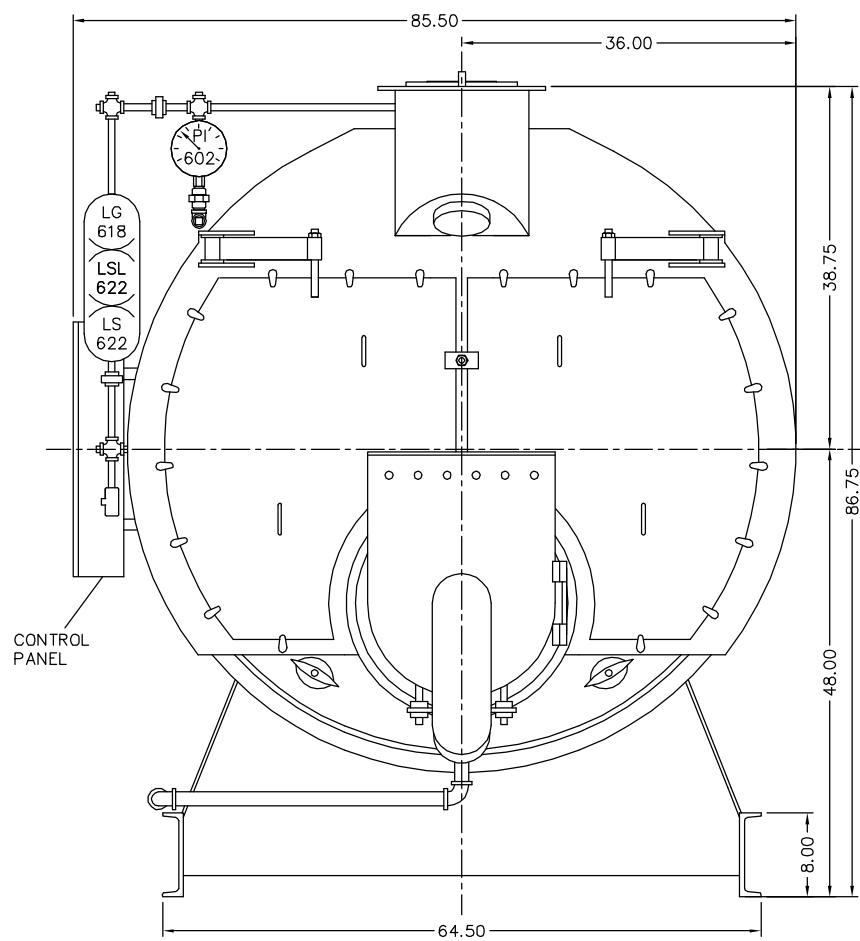

NOTES: THIS DRAWING IS FOR DIMENSIONAL DATA ONLY. SEE PIPING & INSTRUMENT DRAWINGS FOR ACTUAL TRIM & INSTRUMENTATION PROVIDED. ALL DIMENSIONS IN INCHES UNLESS OTHERWISE NOTED. MINIMUM BOILER SIDE & REAR AISLE CLEARANCE: 36.00. ELECTRICAL PANEL LOCATIONS SHOWN ARE APPROXIMATE; CONSULT FACTORY IF PLACEMENT IS CRITICAL. REFER TO NATIONAL ELECTRICAL CODE (NFPA-70) FOR REQUIRED WORKING CLEARANCE ABOUT PANELS; CONSULT LOCAL CODES WHICH MAY SUPERCEDE THESE REQUIREMENTS. BOILER COMPLETELY COVERED WITH 2" INSULATION & NONCORRODING STEEL JACKET.

DWG NO.	300B0418-01
REVISIONS	
A	4/25/12 MN FLUE OUTLET WAS 26.00. UPDATED RELATED DIMENSIONS. LENGTH W/ TUBE PULL WAS 251.63.



THIS DRAWING IS THE PROPERTY OF THE JOHNSTON BOILER COMPANY. THE DISCLOSURES CONTAINED ON THIS DRAWING ARE MADE WITH THE UNDERSTANDING THAT THEY ARE CONFIDENTIAL AND WILL NOT BE USED IN ANY WAY DETRIMENTAL TO THIS COMPANY'S INTEREST.

SCALE	NONE	JOHNSTON BOILER COMPANY	S0#
DATE	3-7-03		
DRAWN	JRS	FERRYSBURG, MICHIGAN 49409	
CHECKED		DIMENSIONAL DIAGRAM - XID	
APPROVED		PFXA200/250-2G150S	
DWG. NO.	300B0418-01	REV	A