NOTES:

1. MINIMUM AISLE CLEARANCE 36" FROM BOILER SIDES AND REAR. (THIS REQUIREMENT MAY VARY WITH LOCATION. CHECK STATE AND LOCAL CODES IN THE AREA OF INSTALLATION.)
2. OPTIONS AND ADDITIONAL EQUIPMENT ORDERED MAY AFFECT OVERALL DIMENSIONS. DRAWINGS ARE FOR STANDARD BOILER PACKAGE.

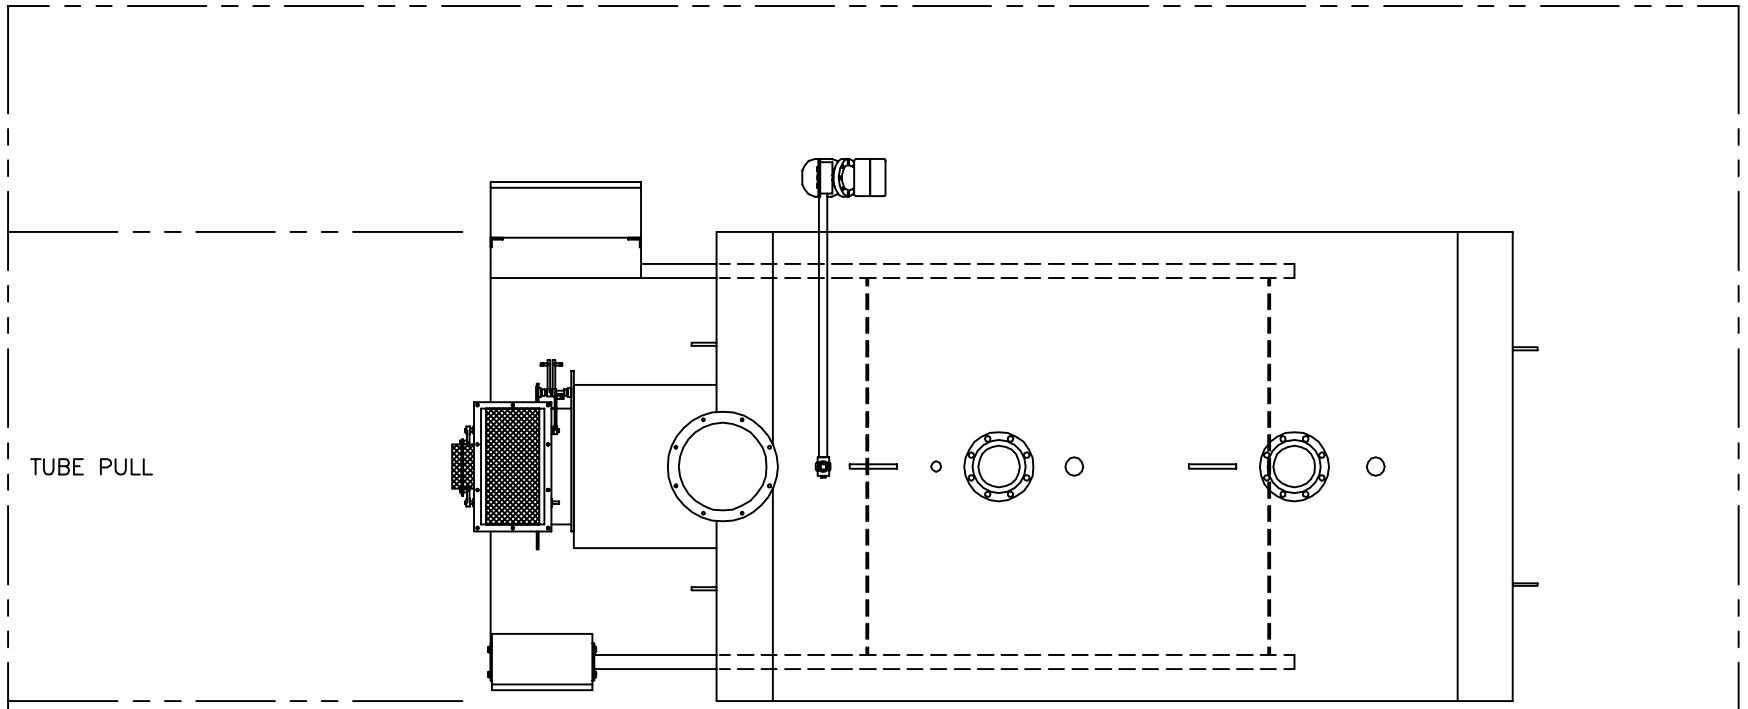

DOOR SWING AND AISLE CLEARANCE

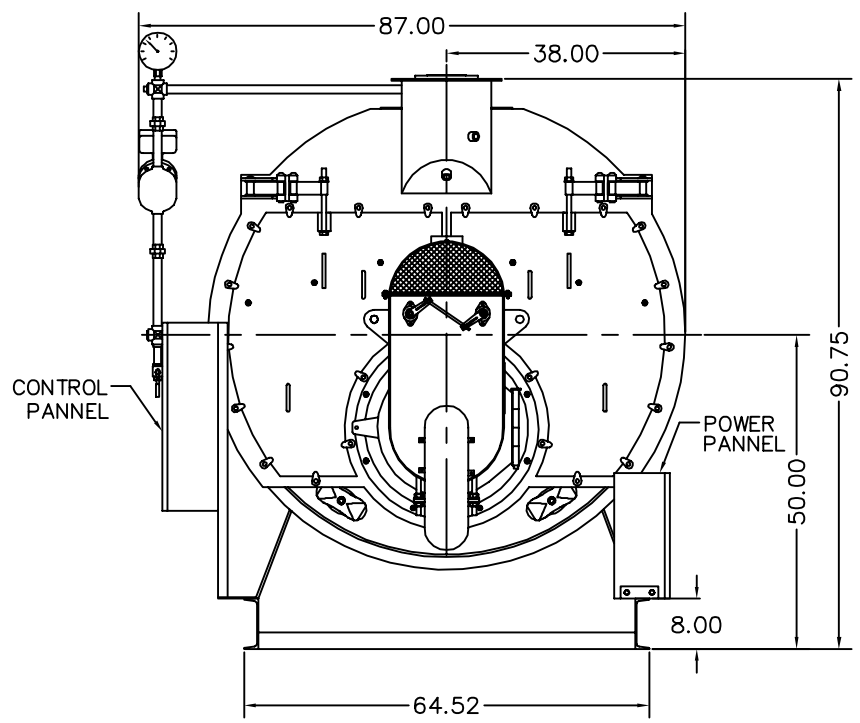

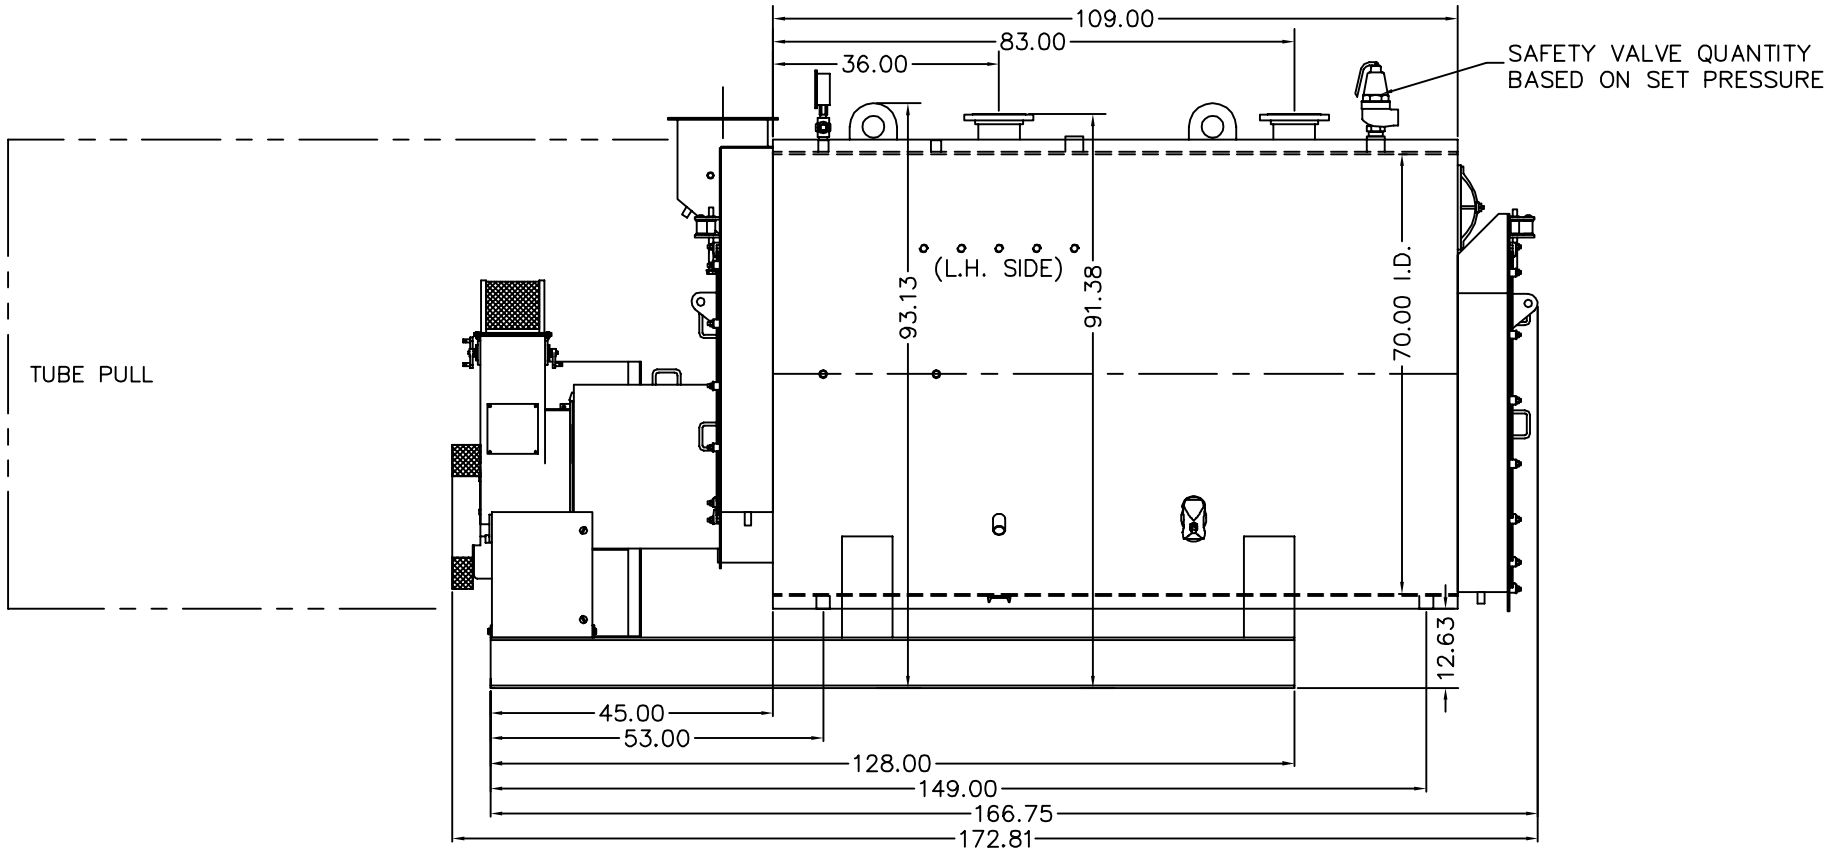

DWG NO. 300B0451
REVISIONS

REFERENCE DRAWINGS

PV:	#101B0919
PV BASE:	#201B0261
FR FLUE BOX:	#205B0159
RR FLUE BOX:	#206B0156
BLWR HOUSING:	#216B0112
PLENUM:	#212B0171

JOHNSTON BOILER COMPANY

THIS DRAWING IS THE PROPERTY OF THE JOHNSTON BOILER COMPANY. THE DISCLOSURES CONTAINED ON THIS DRAWING ARE MADE WITH THE UNDERSTANDING THAT THEY ARE CONFIDENTIAL AND WILL NOT BE USED IN ANY WAY DETRIMENTAL TO THIS COMPANY'S INTEREST.

SCALE CAD/FULL
DATE 2-22-07
DRAWN JRS
CHECKED
APPROVED

JOHNSTON BOILER COMPANY
FERRYSBURG, MICHIGAN 49409

SO#

BOILER TEMPLATE – 509N
PFTA–125–4 30#W

DWG. NO. 300B0451 –01

REV