NOTES:

1. MINIMUM AISLE CLEARANCE 36" FROM BOILER SIDES AND REAR. (THIS REQUIREMENT MAY VARY WITH LOCATION. CHECK STATE AND LOCAL CODES IN THE AREA OF INSTALLATION.)
2. OPTIONS AND ADDITIONAL EQUIPMENT ORDERED MAY AFFECT OVERALL DIMENSIONS. DRAWINGS ARE FOR STANDARD BOILER PACKAGE.

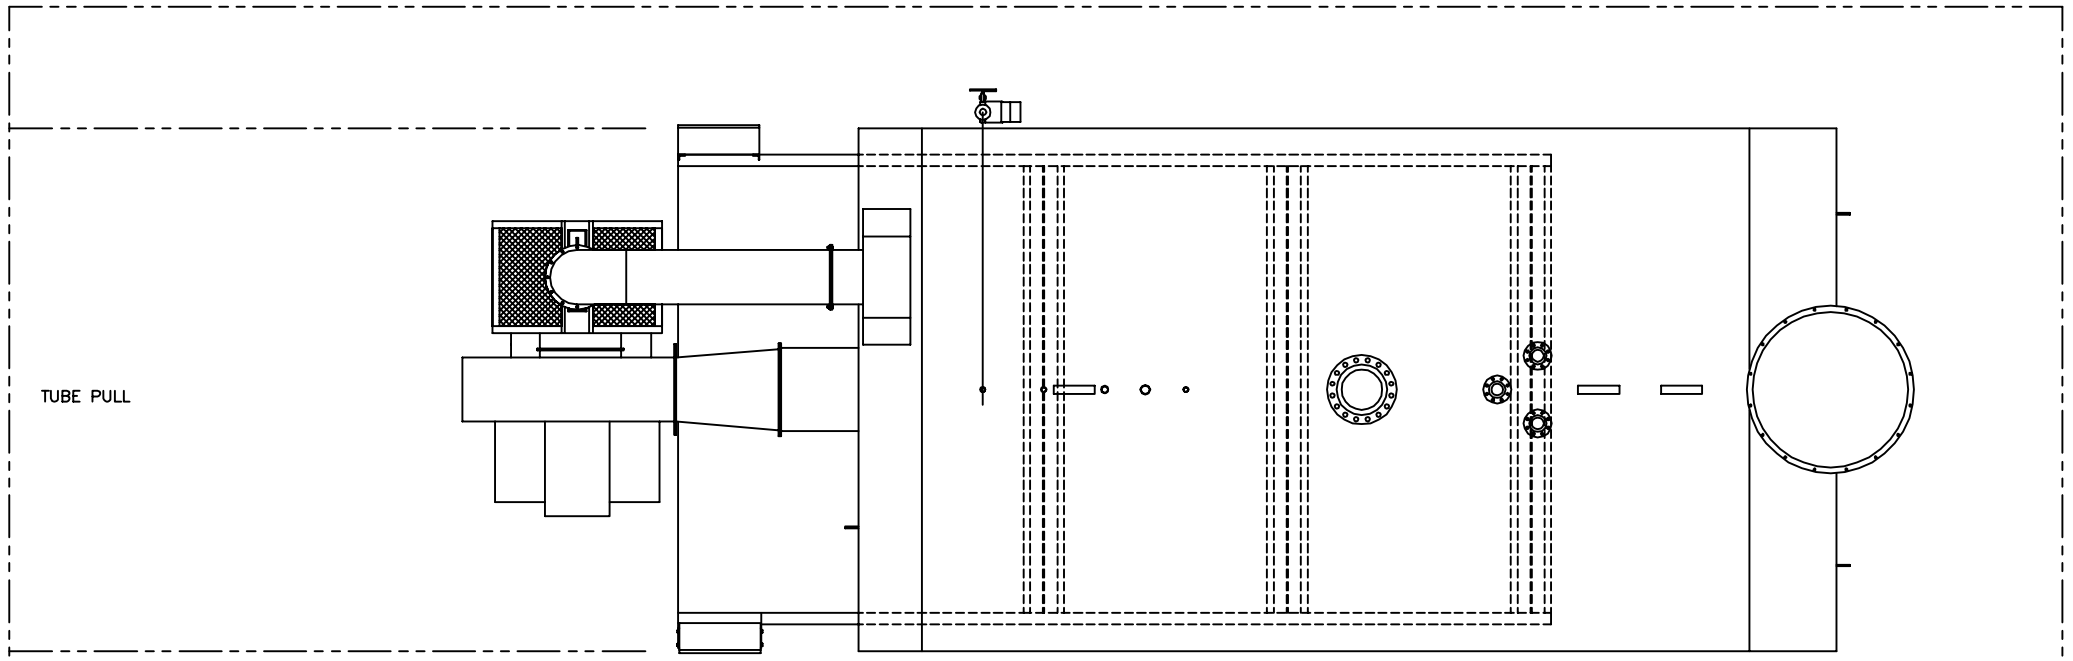

DOOR SWING AND AISLE CLEARANCE

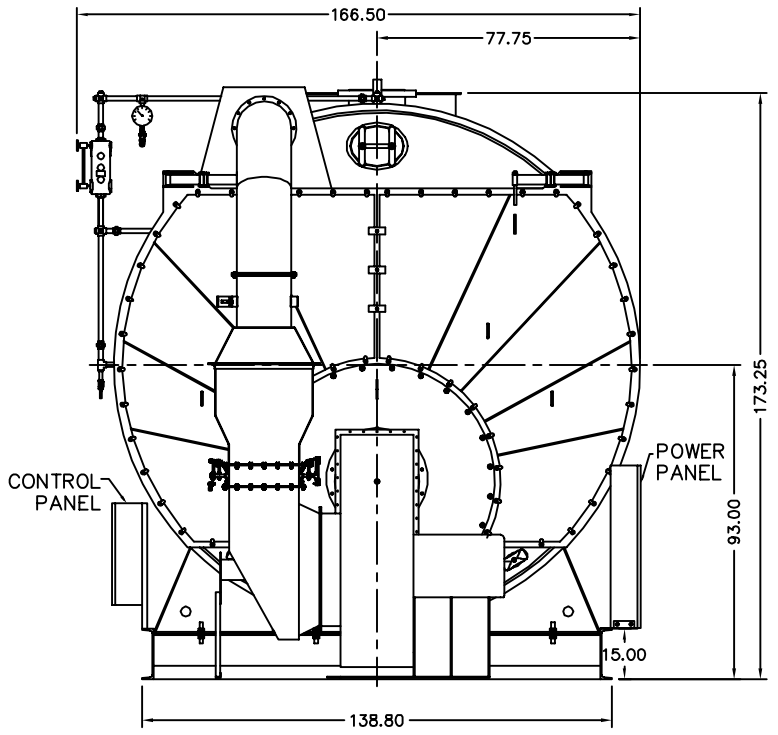

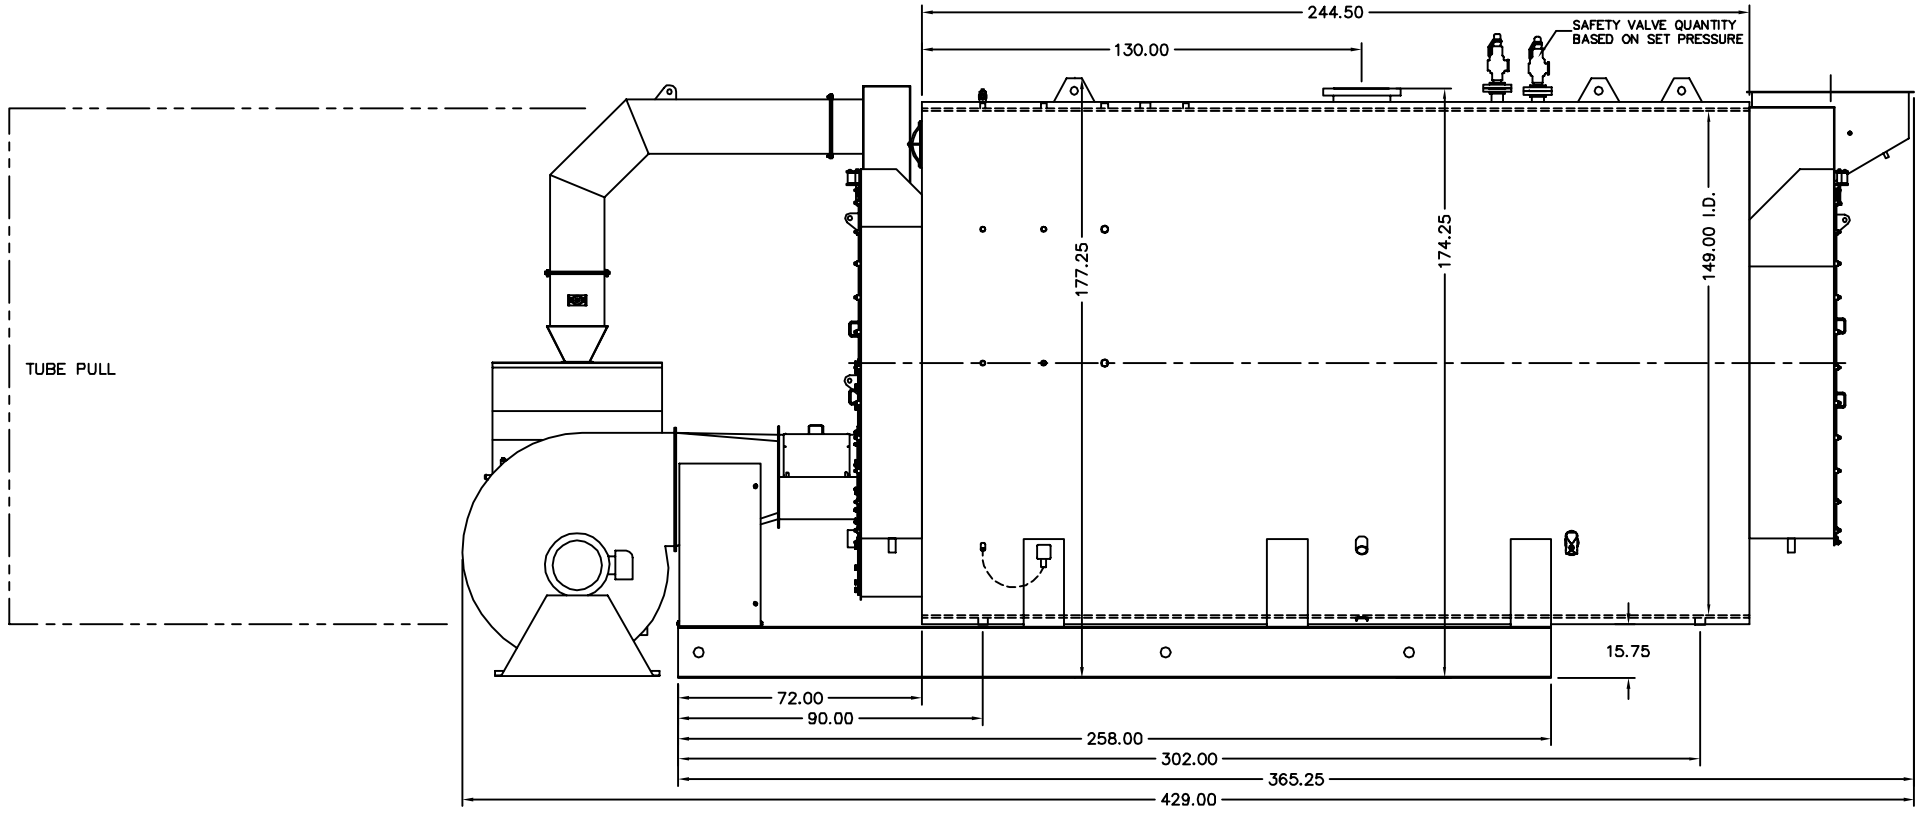

DWG NO.	REVISIONS		
300B0356	A	1-31-07	JRS

REVISED FOR BURNER, CHANGED STACK OUTLET DIAMETER, ADDED DIMENSIONS, UPDATED TUBE PULL

REFERENCE DRAWINGS

PV:	#101B0731
PV BASE:	#201B0051
FR FLUE BOX:	#205B0115
RR FLUE BOX:	#206B0128
PLENUM:	#212B0120

JOHNSTON BOILER COMPANY

THIS DRAWING IS THE PROPERTY OF THE JOHNSTON BOILER COMPANY. THE DISCLOSURES CONTAINED ON THIS DRAWING ARE MADE WITH THE UNDERSTANDING THAT THEY ARE CONFIDENTIAL AND WILL NOT BE USED IN ANY WAY DETRIMENTAL TO THIS COMPANY'S INTEREST.

SCALE	CAD/FULL
DATE	10-5-00
DRAWN	CSP
CHECKED	
APPROVED	

JOHNSTON BOILER COMPANY
FERRYSBURG, MICHIGAN 49409

SO#

BOILER TEMPLATE - 509
PFTS1800-3-150#S

DWG. NO. 300B0356-02

REV A